



**NOTES:**  
 1. 3" BINDER COURSE AND 1 1/2" TOP COURSE TO BE USED FOR RESTORATION OF PAVEMENT WITHIN CITY ROADS.  
 2. EXCAVATIONS ARE TO BE SAW CUT SMOOTH-ALL EDGES TACK COATED, AND ALL SEAMS SEALED WITH A HOT POLYMER MODIFIED CRACK SEALANT.  
 3. IF EXISTING ASPHALT PAVEMENT DEPTH IS GREATER THAN THE PROPOSED ASPHALT PAVEMENT SECTION, INCREASE PROPOSED ASPHALT BINDER THICKNESS TO MATCH EXISTING.

**MILLED KEYWAY DETAIL**  
NOT TO SCALE

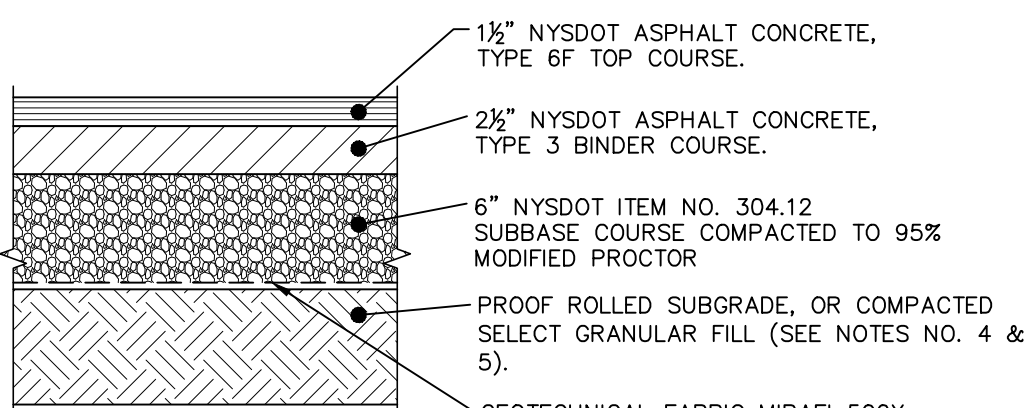


**NOTES:**  
 1. MATERIALS AND METHODS OF CONSTRUCTION SHALL BE IN CONFORMANCE WITH THE NEW YORK STATE DEPARTMENT OF TRANSPORTATION (NYSDOT) STANDARD SPECIFICATIONS FOR CONSTRUCTION AND MATERIALS, LATEST REVISION.  
 2. SUBGRADE SHALL NOT INCLUDE FROZEN MATERIALS, DEBRIS, ORGANIC MATERIALS, LARGE STONES OR OTHER UNSUITABLE MATERIALS.  
 3. TACK COAT WHEN SPECIFIED OR CALLED OUT IN THESE DRAWINGS OR REQUIRED BY THE REFERENCED SPECIFICATIONS SHALL CONFORM WITH SECTION 407-TACK COAT OF THE ABOVE REFERENCED NYSDOT STANDARD SPECIFICATIONS.  
 4. WHERE IT IS NECESSARY TO PLACE FILL FOR PURPOSES OF BRINGING THE SUBGRADE ELEVATION UP TO A SPECIFIED GRADE, THE FILL MATERIAL PLACED SHALL BE IN CONFORMANCE WITH SECTION 203-EXCAVATION AND EMBANKMENT OF THE ABOVE REFERENCED NYSDOT STANDARD SPECIFICATIONS.  
 5. IT IS EXPECTED THAT THE EXISTING SITE SUB-SOILS ARE SUITABLE IF UNSUITABLE SOILS ARE ENCOUNTERED DURING CONSTRUCTION, THE CONTRACTOR SHALL CONTACT THE ENGINEER FOR POSSIBLE MODIFICATIONS TO THE PAVEMENT DETAIL.

**PAVEMENT SECTION DETAIL**  
NOT TO SCALE

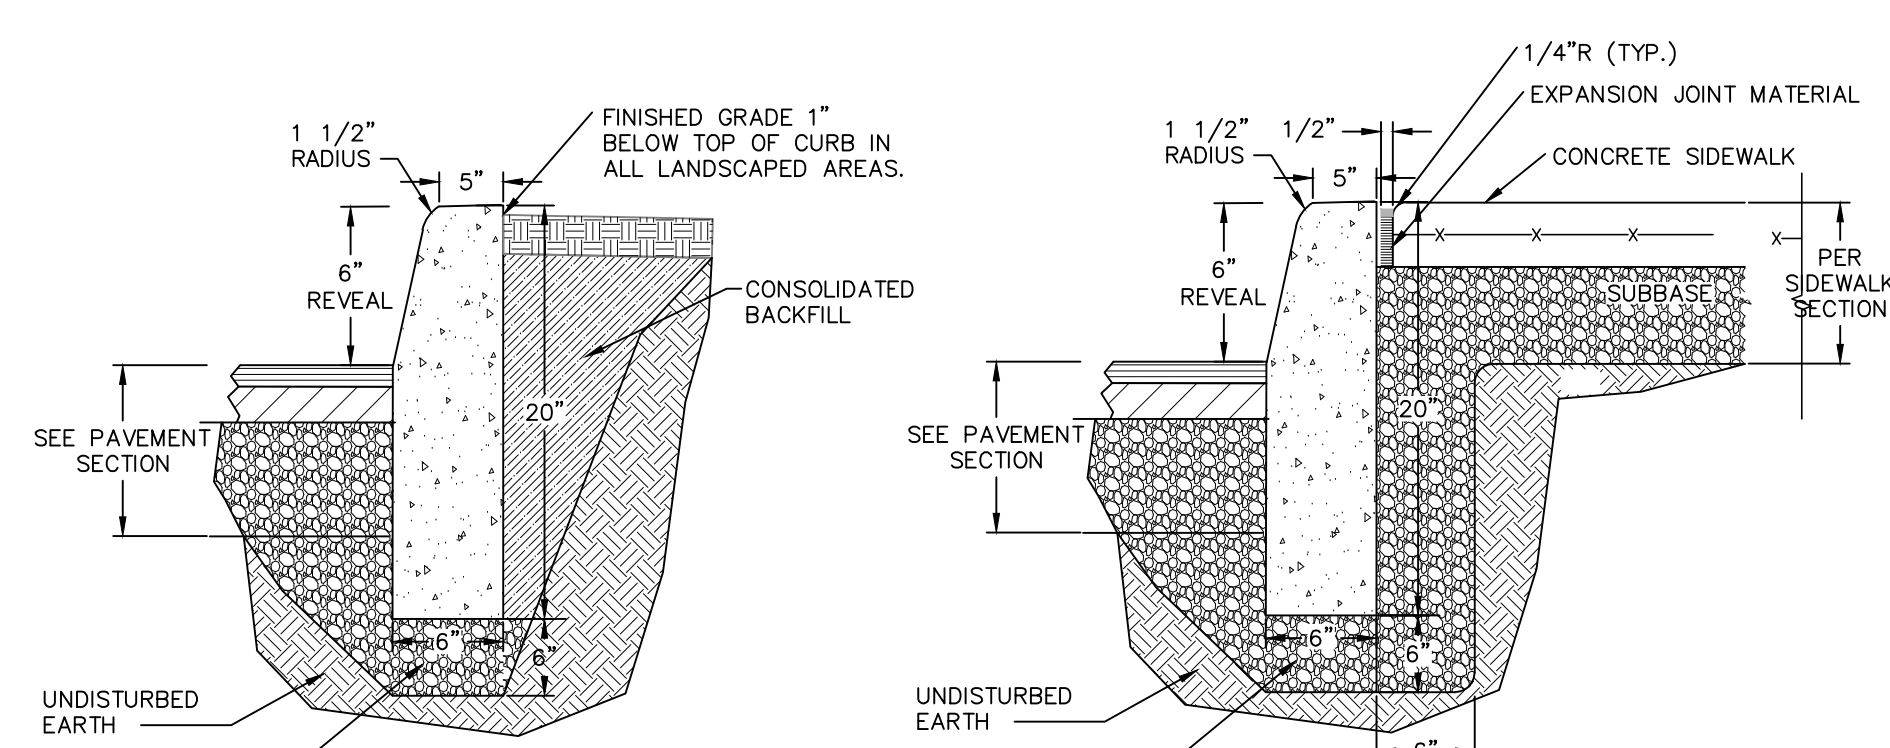


**NOTES:**  
 1. CONCRETE CURB SHALL BE 4000 PSI CAST-IN-PLACE, AND IN ACCORDANCE WITH NYSDOT STANDARD SPECIFICATION SECTION 609.  
 2. EXPANSION JOINTS OF 1/2" CELLULOSE OR SIMILAR MATERIAL SHALL BE PLACED AT 10 FOOT INTERVALS.  
 3. FOR MOUNTABLE CURBS ABUTTING SIDEWALK OR OTHER HARDSCAPE, REFER TO "ABUTTING SIDEWALK" DETAIL.


**CAST-IN-PLACE CONCRETE CURB DETAIL**  
NOT TO SCALE

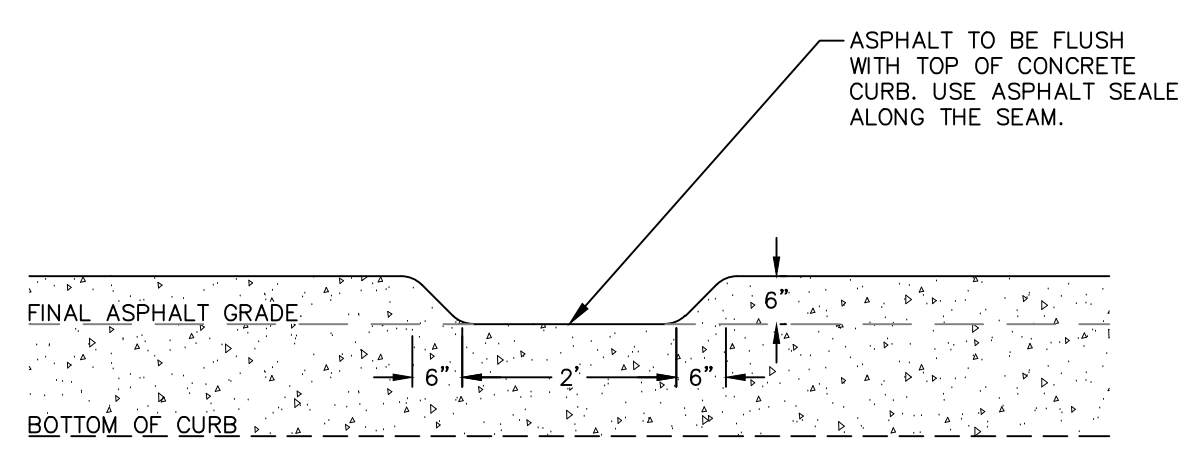


**CONCRETE CURB BREAK DETAIL**  
NOT TO SCALE

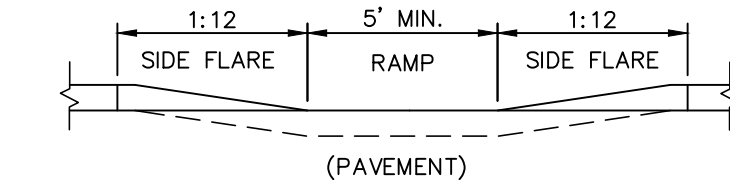

**SECTION B-B**

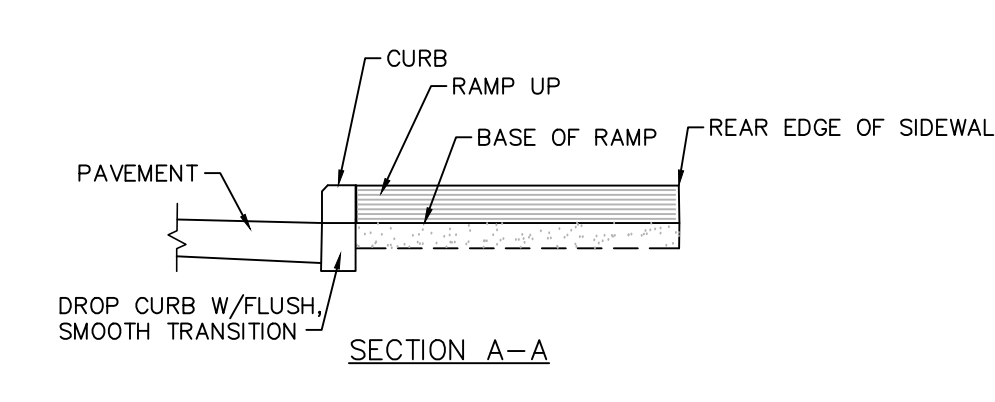


**SECTION A-A**

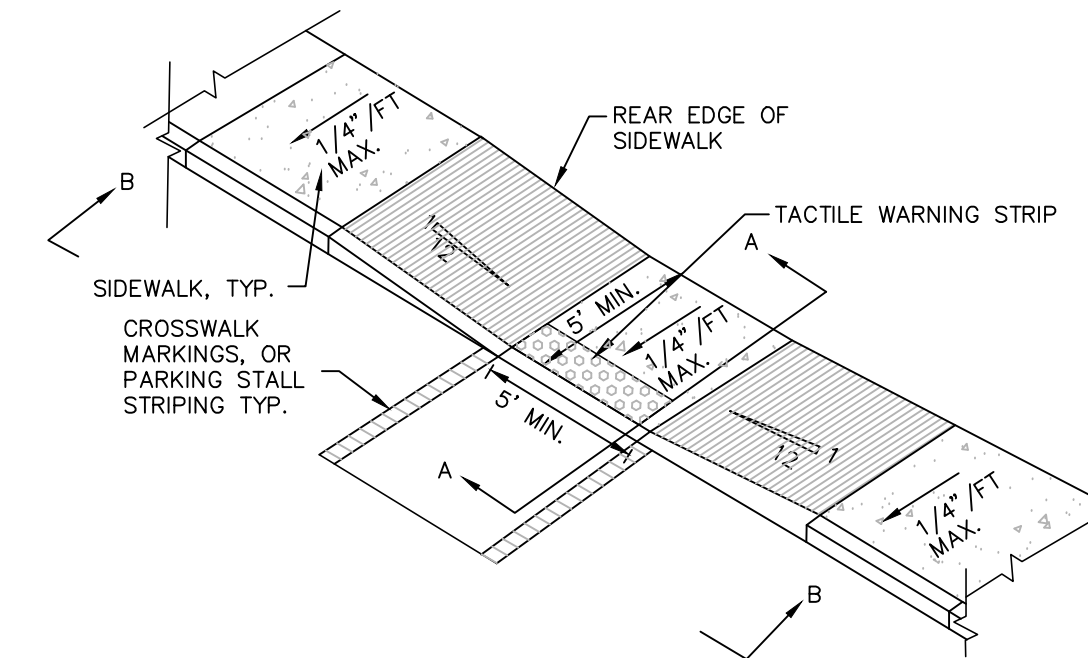


**NOTES:**  
 1. ALL WORK SHALL CONFORM WITH THE NYSDOT STANDARD SPECIFICATION FOR CONSTRUCTION AND MATERIALS DATED JANUARY 2, 2002 AND ALL ADDENDA THEREIN; SPECIFICALLY SECTION 608- SIDEWALKS, DRIVEWAYS, AND BICYCLE PATHS.  
 2. SLOPE RAMP AND SIDE FLARES AS INDICATED IN THE PLANS OR AS ORDERED BY THE ENGINEER.  
 3. TACTILE WARNING STRIPS SHALL BE PROVIDED ON ALL RAMPS IN ACCORDANCE W/ ADA REQUIREMENTS.

**DROP CURB RAMP DETAIL**  
NOT TO SCALE

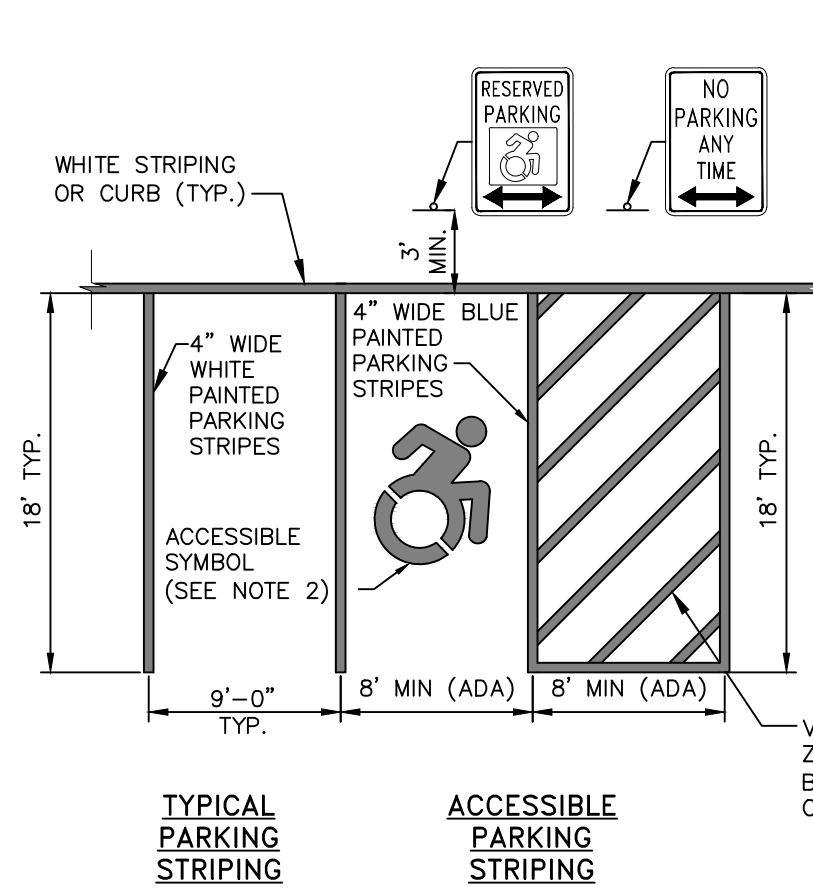


**NOTES:**  
 1. ALL DIMENSIONS SUBJECT TO CURRENT MUNICIPALITY ZONING AND SITE REGULATIONS.  
 2. PAINTED ACCESSIBLE SYMBOL TO BE IN ACCORDANCE WITH NYSDOT AND ADA STANDARDS.  
 3. IF PARKING ABUTS A SIDEWALK, THEN THE REGULATORY SIGNS SHALL BE PLACED BEHIND THE SIDEWALK.


**PARKING AND STRIPING DETAIL**  
NOT TO SCALE

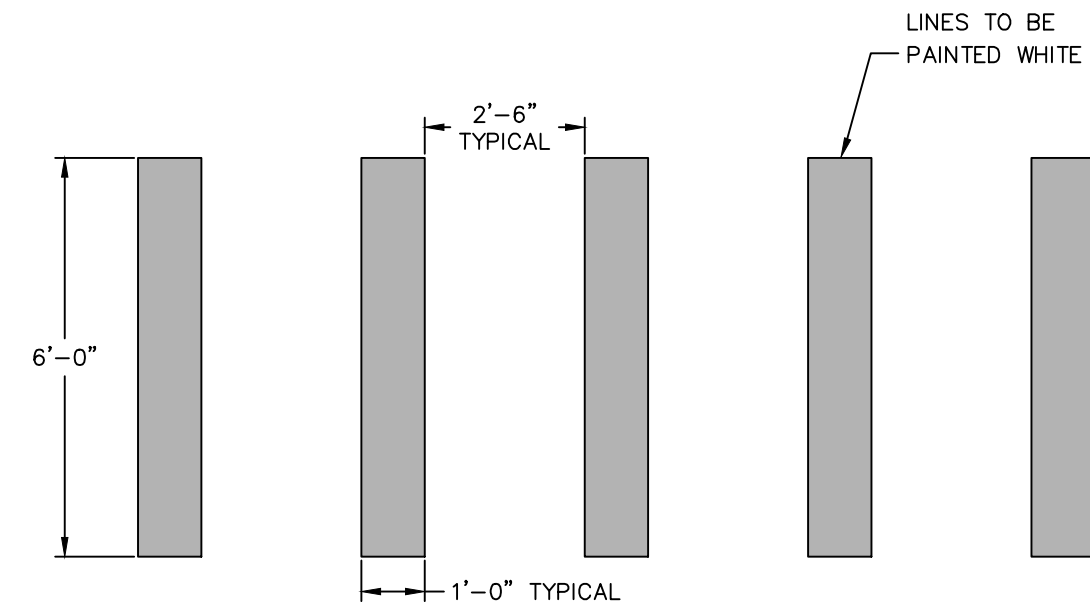


**PAINTED CROSSWALK DETAIL**  
NOT TO SCALE

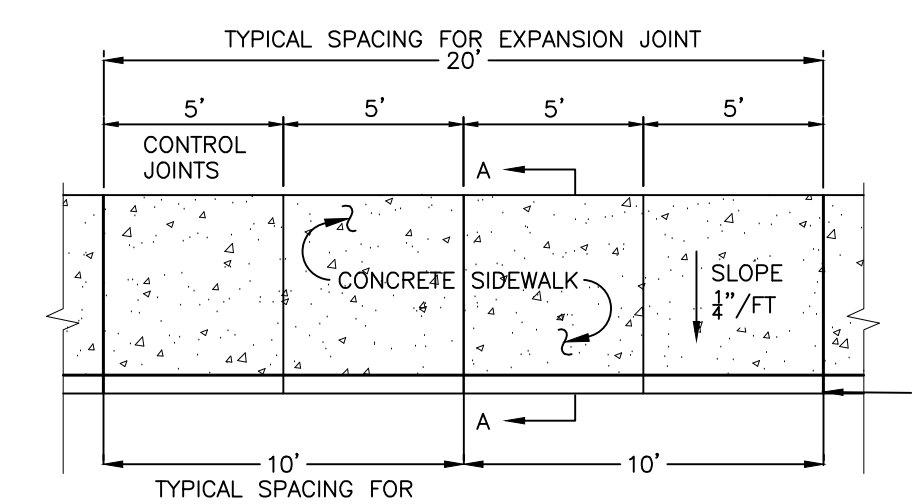


**EXPANSION JOINT**

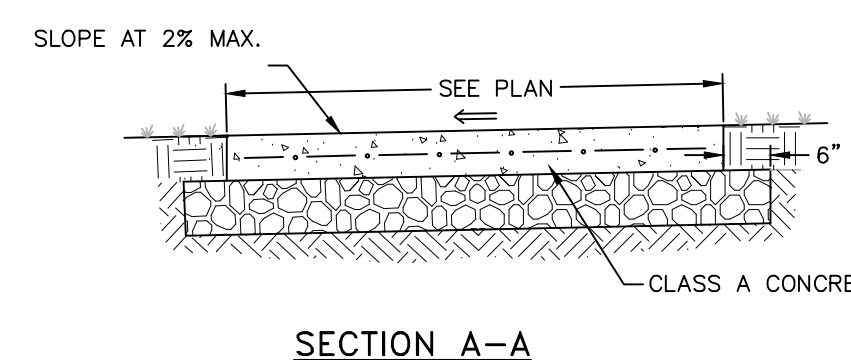

**SECTION A-A**

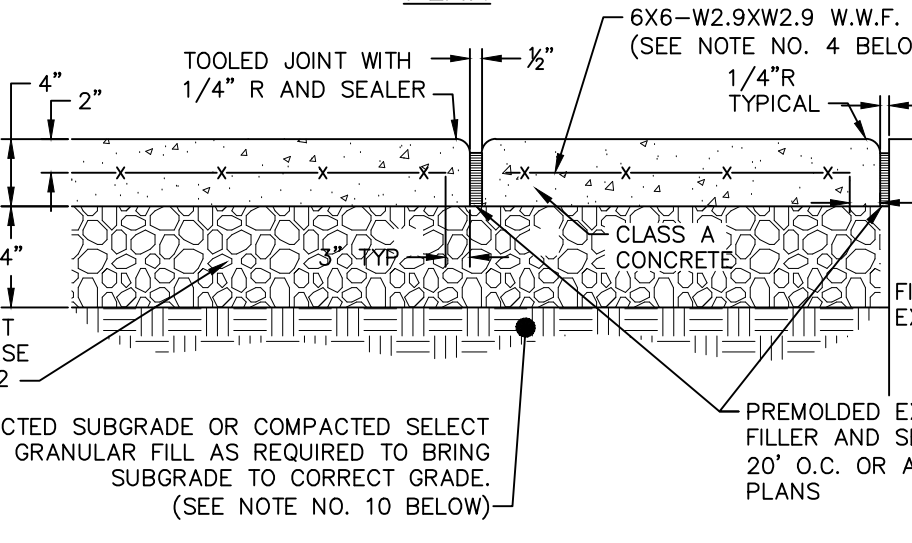


**CONTROL JOINT**

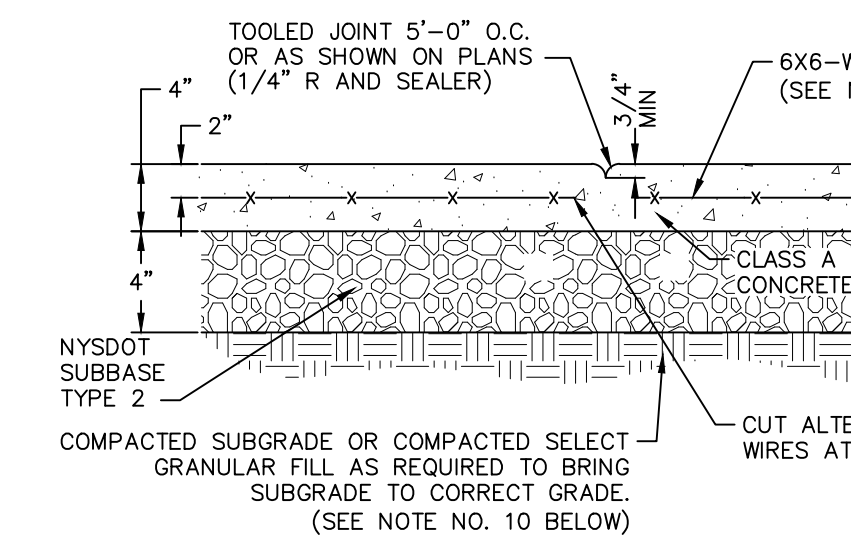

**CONTROL JOINT**


**NOTES:**  
 1. 10' SPACING OF CONTROL JOINTS SHALL BE USED FOR CAST IN PLACE CONCRETE CURBS.  
 2. MATERIAL AND METHODS OF CONSTRUCTION SHALL BE IN CONFORMANCE WITH THE NEW YORK STATE DEPARTMENT OF TRANSPORTATION (NYSDOT) STANDARD SPECIFICATIONS FOR CONSTRUCTION AND MATERIALS, LATEST REVISION.  
 3. ALL CONCRETE SHALL BE 3500 PSI CLASS A CONCRETE. CONCRETE MATERIALS, PLACEMENT, AND CONSTRUCTION SHALL CONFORM WITH SECTION 500 OF THE ABOVE REFERENCED NYSDOT STANDARD SPECIFICATIONS.  
 4. REINFORCING STEEL SHALL CONFORM WITH SECTION 556 - REINFORCING STEEL FOR CONCRETE STRUCTURES OF THE ABOVE REFERENCED NYSDOT STANDARD SPECIFICATIONS AND AS SPECIFICALLY CALLED OUT IN THE DRAWINGS.  
 5. ALL EXPOSED SURFACES SHALL HAVE A BROOM TEXTURED FINISH.  
 6. EXPANSION JOINTS SHALL BE LOCATED A MAXIMUM OF 20' ON CENTER, OR AS INDICATED ON PLANS.  
 7. JOINTS SHALL NOT BE SAW CUT.  
 8. EXPOSED CONCRETE SURFACES SHALL BE TREATED WITH "SUREBOND"/"SAFEbond" 58-7000 INTENSIFIER BRIGHT PROTECTOR AND SIDEWALK SEALER, OR EQUAL RATE AND METHOD OF APPLICATION SHALL BE IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.  
 9. SUBGRADE MATERIAL SHALL CONFORM WITH SECTION 304 OF THE ABOVE REFERENCED NYSDOT STANDARD.  
 10. WHERE IT IS NECESSARY TO PLACE FILL FOR PURPOSES OF BRINGING THE SUBGRADE ELEVATION UP TO A SPECIFIED GRADE, THE FILL MATERIAL PLACED SHALL BE IN CONFORMANCE WITH SECTION 203-EXCAVATION AND EMBANKMENT OF THE ABOVE REFERENCED NYSDOT STANDARD SPECIFICATIONS.  
 11. ALL WORK SHALL CONFORM WITH SECTION 608-SIDEWALK, DRIVEWAYS, AND BICYCLE PATHS OF THE ABOVE REFERENCED NYSDOT STANDARD SPECIFICATIONS.

**CONCRETE SIDEWALK DETAIL**  
NOT TO SCALE

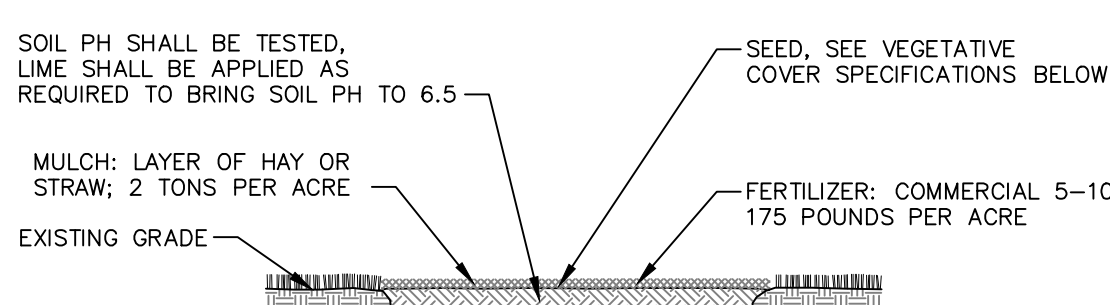


**NOTES:**  
 1. TOPSOIL, SEED, MULCH, AND FERTILIZER DISTURBED SOIL AREAS THAT WILL BE LEFT EXPOSED FOR 14 DAYS OR MORE.  
 2. SEED MIXTURE FOR USE ON LAWNS IN SUNNY AREAS:  
 60% KENTUCKY BLUE GRASS BLEND 114 POUNDS PER ACRE  
 20% PERENNIAL PEGRASS 35 POUNDS PER ACRE  
 15% FINE FESCUE 26 POUNDS PER ACRE  
 3. SEED MIXTURE FOR USE IN SHADY AREAS:  
 80% BLEND OF SHADE TOLERANT PENTSTEMON BLUEGRASS 138 POUNDS PER ACRE  
 20% FINE FESCUE 32 POUNDS PER ACRE  
 175 POUNDS PER ACRE  
 4. SEED BETWEEN APRIL 1ST AND MAY 15TH OR AUGUST 15TH AND OCTOBER 15TH, SEEDING MAY OCCUR BETWEEN MAY 15TH AND AUGUST 15TH IF ADEQUATE IRRIGATION IS PROVIDED.  
 5. TOPSOIL SHALL HAVE AT LEAST 6% BY WEIGHT OF FINE TEXTURED STABLE ORGANIC MATERIAL, AND NO GREATER THAN 20% TOPSOIL SHALL HAVE NOT LESS THAN 20% FINE TEXTURED MATERIAL, PASSING THE NO. 200 SIEVE AND NOT MORE THAN 10% CLAY.

**TOPSOIL, SEED AND MULCH DETAIL**  
NOT TO SCALE

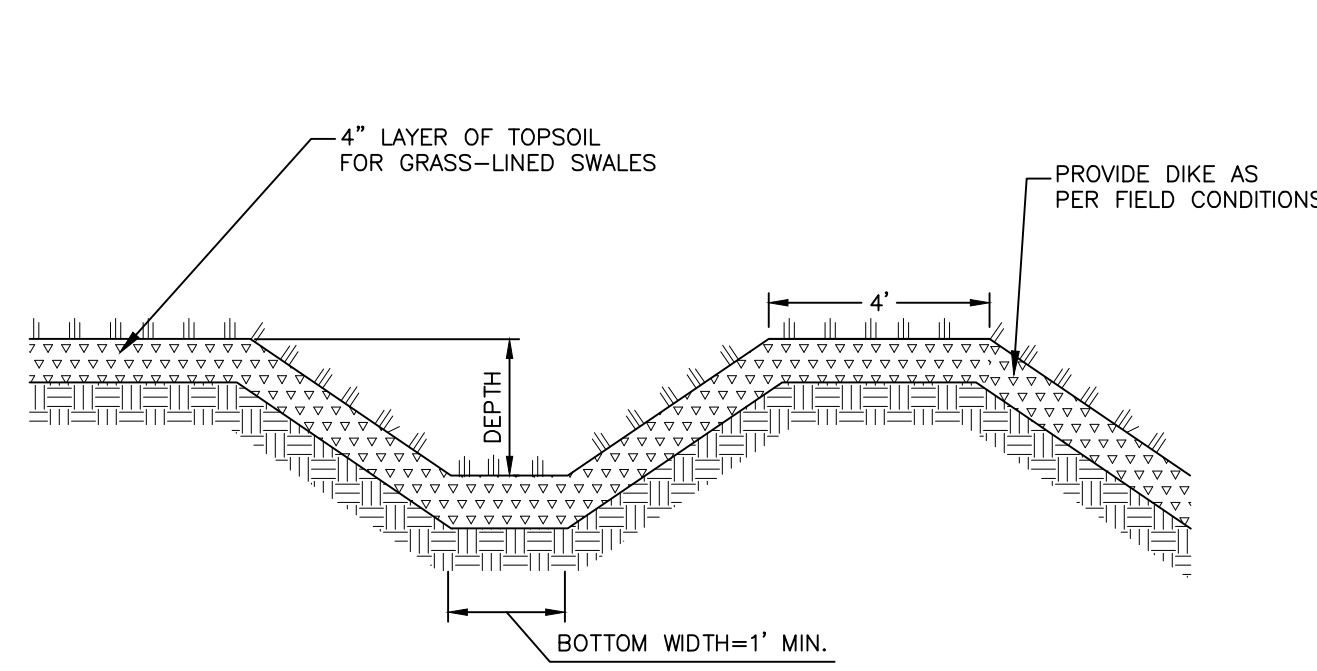


**NOTES:**  
 1. MINIMUM 1" DEPTH AND 1" WIDTH FOR ALL SWALES.  
 2. SWALE SHALL BE SEEDED WITH FAST GERMINATING RYE 15 TO 25 POUNDS PER 1,000 SQUARE FEET AND MULCHED.

**GRASS LINED SWALE/DIKE DETAIL**  
NOT TO SCALE

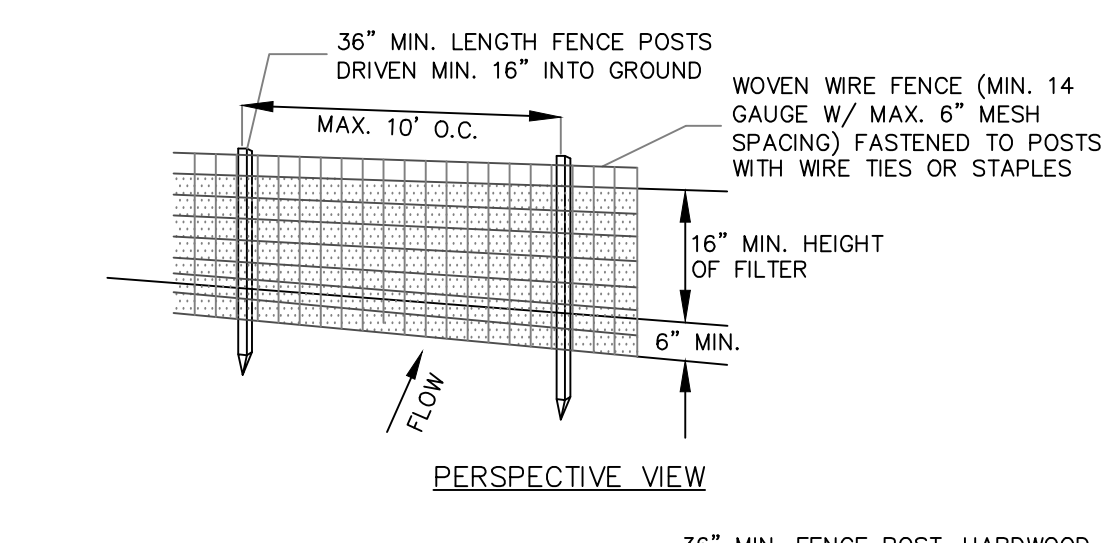


**NOTES:**  
 1. FILTER CLOTH TO BE FASTENED SECURELY TO WOVEN WIRE FENCE WITH TIES SPACED EVERY 24" AT TOP AND MID SECTION.  
 2. WHEN TWO SECTIONS OF FILTER CLOTH ADJOIN EACH OTHER THEY SHALL BE OVER-LAPPED BY SIX INCHES AND FOLDED. FILTER CLOTH SHALL BE EITHER FILTER X MARIAT DOCK, STABILIZED THORN OR APPROVED EQUAL.  
 3. PREFABRICATED UNITS SHALL BE GEOTEX, ENVIROFENCE OR APPROVED EQUAL.  
 4. MAINTENANCE SHALL BE PERFORMED AS NEEDED AND MATERIAL REMOVED WHEN "BULGES" DEVELOP IN THE SILT FENCE.

**SILT FENCE DETAIL**  
NOT TO SCALE

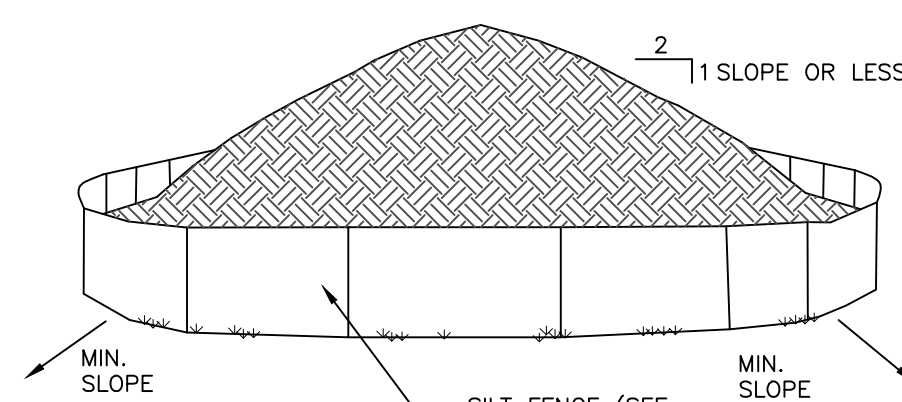


**NOTES:**  
 1. AREA CHOSEN FOR STOCKPILING OPERATIONS SHALL BE DRY AND STABLE.  
 2. EACH PILE SHALL BE SURROUNDED WITH SILT FENCING, THEN STABILIZED WITH VEGETATION OR COVERED.

**TEMPORARY SOIL STOCKPILE DETAIL**  
NOT TO SCALE

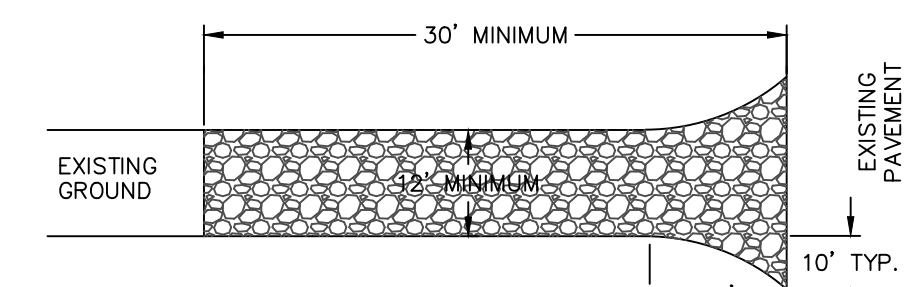


**NOTES:**  
 1. STONE SIZE - USE 1-4 INCH STONE, OR RECLAIMED OR RECYCLED CONCRETE EQUIVALENT.  
 2. LENGTH - NOT LESS THAN 30 FEET FOR A SINGLE RESIDENCE LOT.  
 3. THICKNESS - NOT LESS THAN SIX (6) INCHES.  
 4. WIDTH - 12 FOOT MINIMUM, BUT NOT LESS THAN THE FULL WIDTH AT POINTS WHERE INGRESS OR EGRESS OCCURS. 24 FOOT MINIMUM IF SINGLE ENTRANCE TO SITE.  
 5. GEOTEXTILE - WILL BE PLACED OVER THE ENTIRE AREA PRIOR TO PLACING OF STONE.  
 6. SURFACE WATER - ALL SURFACE WATER FLOWING OR DIVERTED TOWARD CONSTRUCTION ENTRANCES SHALL BE IPIED BEHIND THE ENTRANCE. IF PIPING IS IMPRACTICAL, A MOUNTABLE BERM WITH 5:1 SLOPES WILL BE PERMITTED.  
 7. MAINTENANCE - THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS-OF-WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND AND REPAIR AND/OR CLEANOUT OF ANY MESSAGE USED TO TRAP SEDIMENT. ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACED ONTO PUBLIC RIGHTS-OF-WAY MUST BE REMOVED IMMEDIATELY.  
 8. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH STONE AND WHICH DRAINS INTO AN APPROVED SEDIMENT TRAPPING DEVICE.  
 9. PERIODIC INSPECTION AND NEEDED MAINTENANCE SHALL BE PROVIDED AFTER EACH RAIN.

**STABILIZED CONSTRUCTION ENTRANCE DETAIL**  
NOT TO SCALE

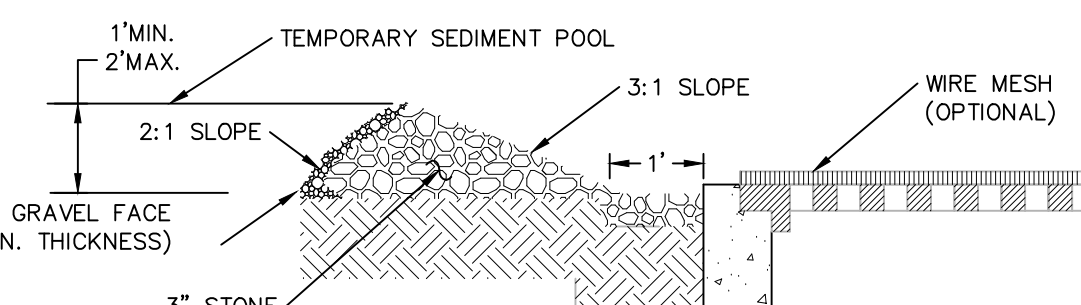

**NOTES:**  
 1. LAY ONE BLOCK ON EACH SIDE OF THE STRUCTURE ON ITS SIDE FOR DOWATERING. FOUNDATION SHALL BE 2 INCHES MINIMUM BELOW REST OF INLET AND BLOCKS SHALL BE PLACED AGAINST INLET FOR SUPPORT.  
 2. HARDWARE CLOTH OR 1/2" WIRE MESH SHALL BE PLACED OVER BLOCK OPENINGS TO SUPPORT STONE.  
 3. USE CLEAN STONE OR DRUMS, 1 1/2-3/4 INCH IN DIAMETER PLACED 2 INCHES BELOW TOP OF THE BLOCK ON A 2:1 SLOPE OR FLATTER.  
 4. FOR STONE STRUCTURES ONLY, A 1 FOOT THICK LAYER OF THE FILTER STONE WILL BE PLACED AGAINST THE 3:1 STONE AS SHOWN ON THE DRAWINGS.  
 5. MAXIMUM DRAINAGE AREA 1 ACRE

**CATCH BASIN INLET PROTECTION DETAIL**  
NOT TO SCALE

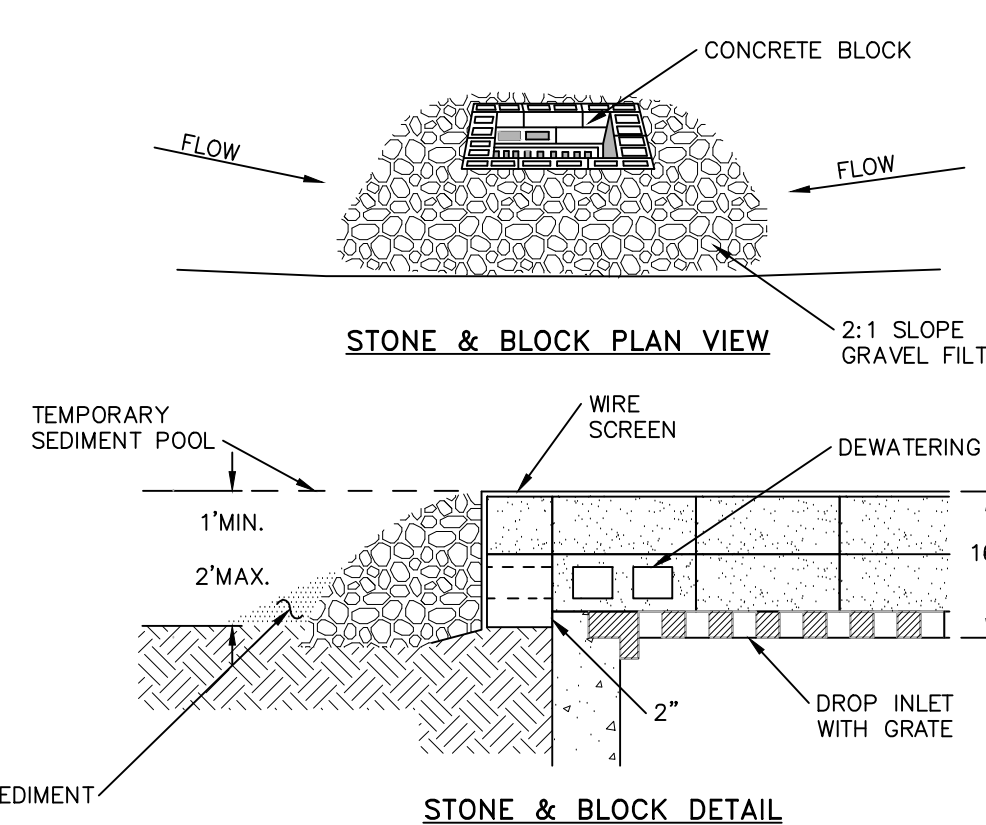


**STONE & BLOCK DETAIL**

CHECKED BY: DCK		REVISIONS:	
NO.	DATE	BY	DESCRIPTION
1			
2			
3			

DRAWN BY: CMB		REVISIONS:	
NO.	DATE	BY	DESCRIPTION
1	12/27/18	CMB	PRE PLANNING BOARD COMMENTS
2	1/25/19	CMB	PER PLANNING BOARD COMMENTS
3	2/26/19	CMB	ADDED CURB BREAK DETAIL

**DigiSafely**  
New York  
800-962-7962  
Call for more information  
100 West Street, 10th Floor  
New York, NY 10038

**Hudson Land Design**  
HUDSON LAND DESIGN  
PROFESSIONAL ENGINEERING P.C.  
174 MAIN ST., BEACON, NEW YORK 12508  
13 CHAMBERS ST., NEW YORK, NEW YORK 10005  
F: 845-440-6837

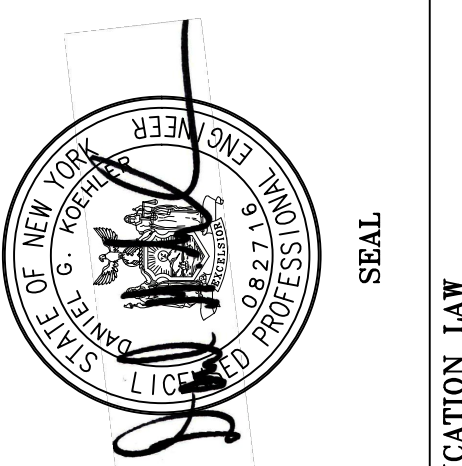

**CONSTRUCTION DETAILS**  
511 FISHKILL AVENUE  
511 FISHKILL AVENUE  
CITY OF BEACON  
DUTCHESS COUNTY, NEW YORK  
TAX ID: 6650-04-560265

JOB #: 2016041  
DATE: 11/27/18  
SCALE: AS SHOWN  
TITLE: CD-1  
SHEET 12 OF 13  
UNAUTHORIZED ALTERATIONS OR ADDITIONS TO THIS DRAWING IS A VIOLATION OF SECTION 7209.2 OF THE NEW YORK EDUCATION LAW