



DATED: FEBRUARY 21, 2019  
SCALE: NONE

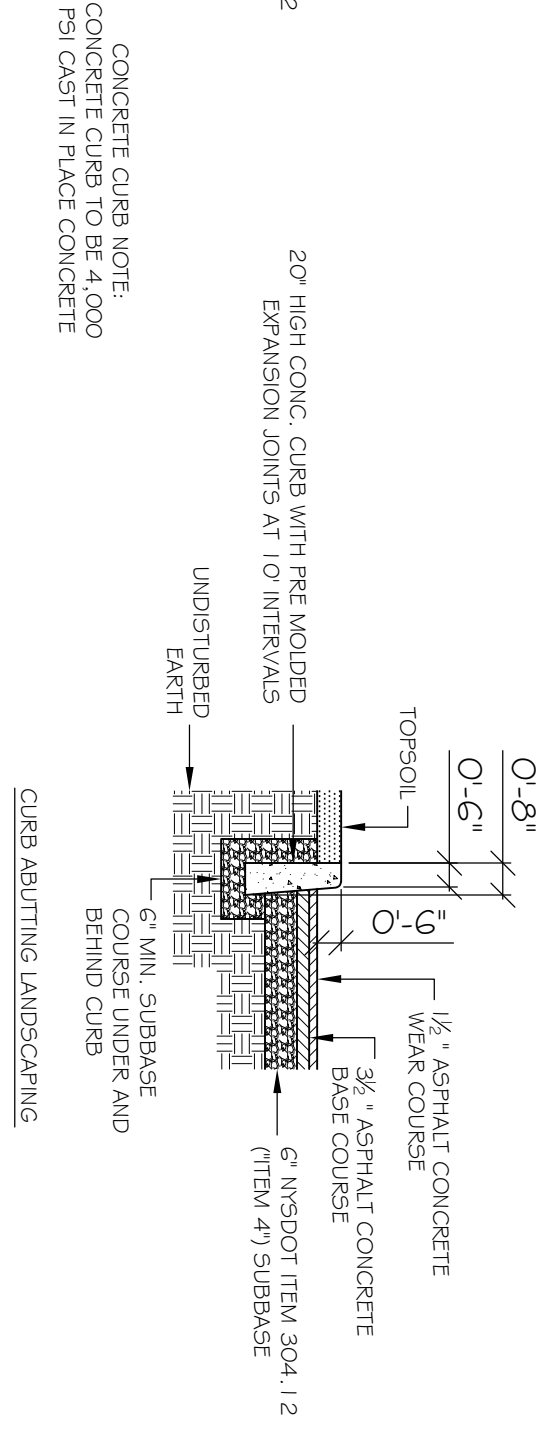

CAST IN PLACE CONCRETE CURB DETAIL  
NOT TO SCALE

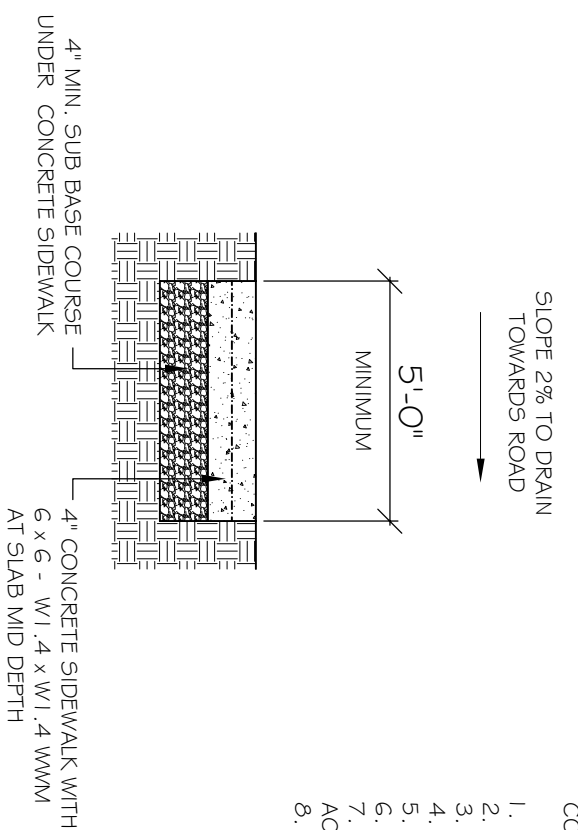


1. ALL CONCRETE SURFACES TO BE 4,000 PSI CAST IN PLACE CONCRETE.
2. PROVIDE HAND TOoled TRANSVERSE JOINTS WITH 1/4" RADIUS EDGES AT 5'-0" O.C. INTERVALS MAX.
3. PROVIDE HAND TOoled LONGITUDINAL JOINTS WITH HAND TOoled EDGES AT 10'-0" O.C. MAX.
4. PROVIDE HAND TOoled TRANSVERSE JOINTS WITH 1/4" RADIUS EDGES AT 5'-0" O.C. INTERVALS MAX.
5. ALL EXPOSED CONCRETE SURFACE TO HAVE BROOK TEXTURE FINISH.
6. JOINTS WILL NOT BE SAWCUT.
7. ALL EXPOSED CONCRETE SURFACE TO BE TREATED WITH SUPERDYE (OR EQUAL) SIDEWALK SEALER IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.
8. PROVIDE HAND TOoled 1/4" RADIUS EDGES AT INTERSECTIONS OF ALL SIDEWAYS.


TYPICAL CONCRETE SIDEWALK SECTION



### CONCRETE SIDEWALK TRANSITION RAMP PLAN

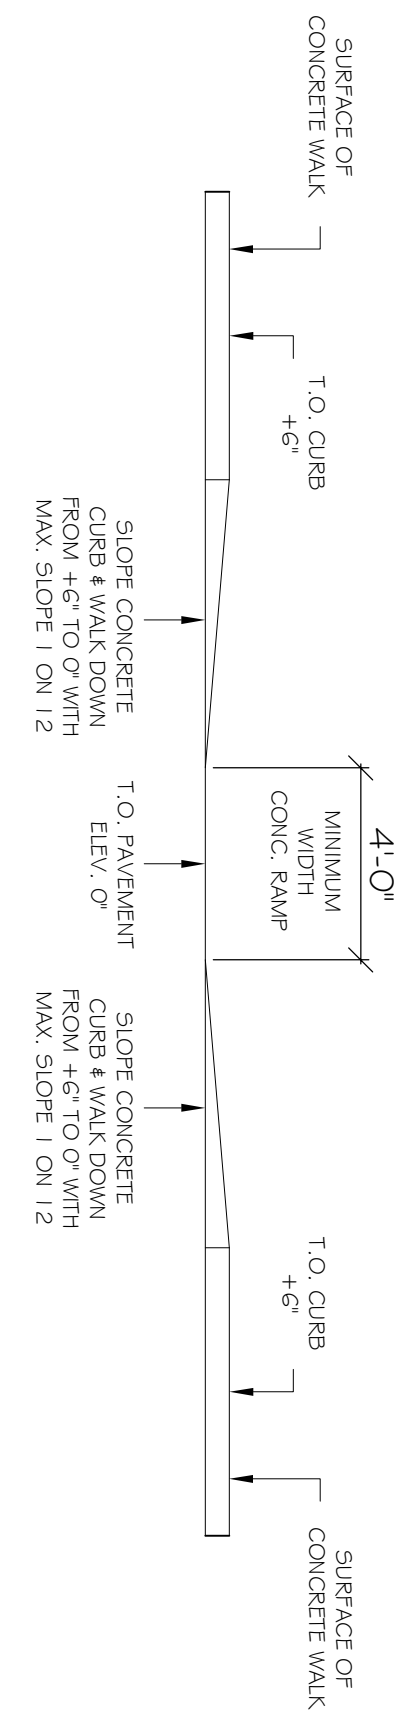

CONCRETE SIDEWALK TRANSITION RAMP ELEVATION

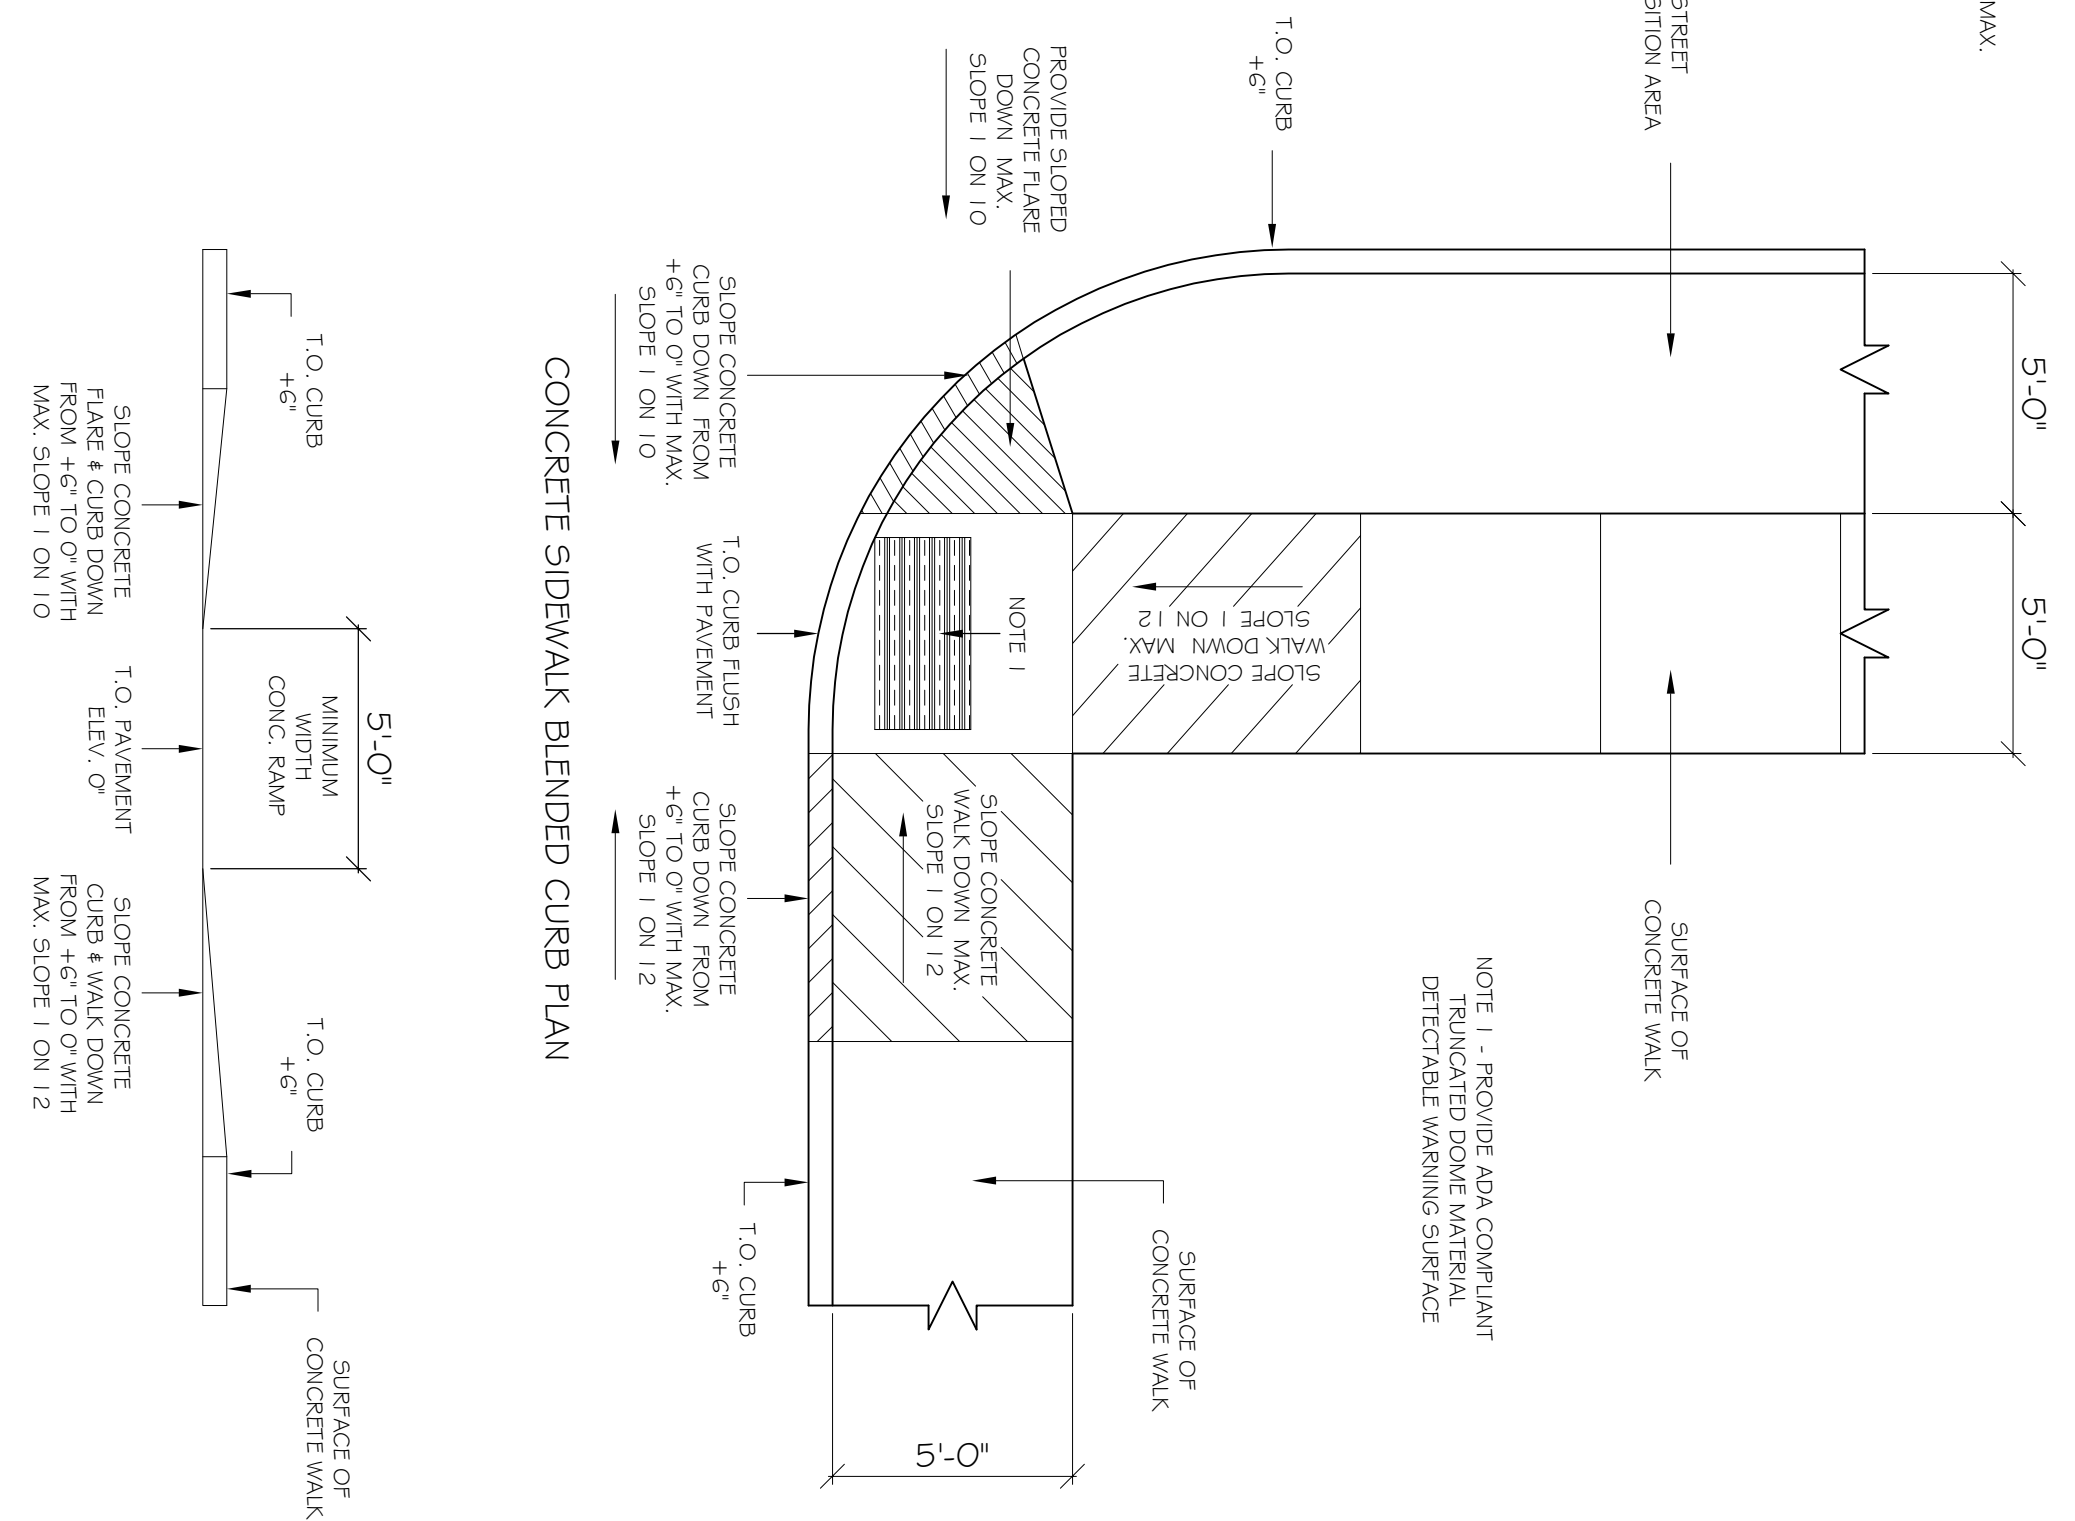

# CONCRETE SIDEWALK BLENDED CURB PLAN

CONCRETE SIDEWALK BLENDED CURB ELEVATION

## ADA COMPLIANT CONCRETE SIDEWALK BLENDED CURB DETAIL