


NOTES:
1. PRECAST CONCRETE CATCH BASIN WITH CONCRETE STRENGTH OF 4,000 PSI @ 28 DAYS.
2. THE DIPS OF ALL PIPES SHALL BE CUT OFF FLUSH WITH THE INSIDE SURFACE OF THE CATCH BASIN AND PARALLEL TO THE DRAINAGE DIRECTION.
3. PIPES SHALL BE PARALLEL TO INTERIOR AND EXTERIOR PRIOR TO BACKFILLING OF STRUCTURE. CONNECTIONS MADE WITHIN 10 FEET OF A WATER MAIN (OR SERVICE LINE) OR A SEWER MAIN (OR SERVICE LATERAL) SHALL BE MADE WATER TIGHT.
4. PROVIDE A MINIMUM 0.1" DROP BETWEEN INLET AND OUTLET INVERTS (MATCH DROWNS FOR PIPES WITH DIFFERENT SIZES) UNLESS OTHERWISE NOTED ON THE PLAN.
5. CATCH BASINS WITH AN INTERIOR DEPTH OF 4' AND GREATER SHALL BE FURNISHED WITH STEEL REINFORCED POLYPROPYLENE PLASTIC STEPS AT 12" INTERVALS.
6. HOPE PIPE SHALL BE PROVIDED WITH WATER TIGHT CONNECTIONS. ADS MODEL N12 W/B OR APPROVED EQUAL.




NOTES:
1. HEAVY DUTY RECTANGULAR STORMWATER INLET GRATE TO BE CAMPBELL FOUNDRY MODEL 2241, OR APPROVED EQUAL.
2. CATCH BASINS TO RECEIVE CURB INLETS ARE: CB 104, CB 301, CB 301A, CB 302, CB 303, CB 304, AND CB 305.
3. HOPE PIPE SHALL BE PROVIDED WITH WATER TIGHT CONNECTIONS. ADS MODEL N12 W/B OR APPROVED EQUAL.

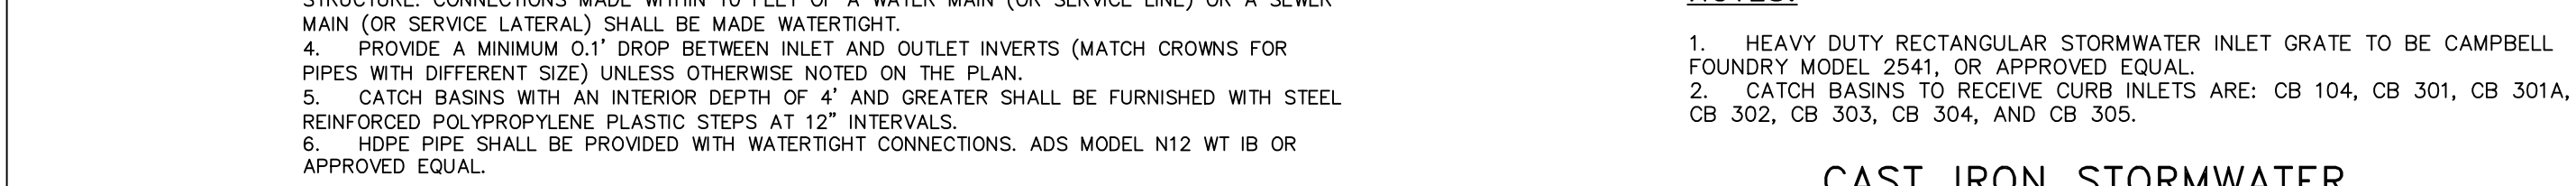

NOTES:
1. ALL TRASH RACKS SHALL HAVE UV PROTECTION MEETING OR EXCEEDING THE REQUIREMENTS OF ASTM D2565-99.
2. TRASH RACKS SHALL BE SECURED PER THE MANUFACTURER'S RECOMMENDATIONS.
3. WHERE HIGH FLOW ORIFICE EXTENDS TO TOP OF STRUCTURE, THE MAXIMUM ALLOWABLE GAP BETWEEN THE TRASH RACKS SHALL BE 4".




NOTES:
1. THE INFILTRATION BASIN SHALL NOT SERVE AS A SEDIMENT TRAP DURING CONSTRUCTION AND SHALL BE PROTECTED FROM CONSTRUCTION ACTIVITY.
2. RELATIVELY LIGHT TRACKED EQUIPMENT IS RECOMMENDED FOR CONSTRUCTION PURPOSES TO AVOID COMPACTION OF THE BASIN FLOOR.
3. A HIGHLY POROUS SURFACE TEXTURE SHALL BE RETAINED ALONG THE BASIN FLOOR, ESPECIALLY WITHIN THE AREA IDENTIFIED AS BEING USED FOR INFILTRATION.
4. ESTABLISH DENSE VEGETATION ON THE BASIN SIDE SLOPES AND FLOOR TO PREVENT EROSION AND SLOUGHING AND TO PROVIDE A NATURAL MEANS OF MAINTAINING RELATIVELY HIGH INFILTRATION RATES. GRASSES OF THE FESCUE FAMILY (ALTA FESCUE, WESTERN FESCUE OR RED FESCUE) ARE SPECIFIED ON THIS PLAN, PRIMARILY DUE TO THEIR ADAPTABILITY TO DRY SANDY SOILS, DROUGHT RESISTANCE, HARDINESS, AND ABILITY TO WITHSTAND BRIEF INUNDATIONS. FESCUE WILL ALSO ALLOW FOR LONG INTERVALS BETWEEN MOWINGS, WHICH SHALL OCCUR TWICE PER YEAR MINIMUM, TYPICALLY IN JUNE AND SEPTEMBER IS SATISFACTORY.
5. THE BERMS SHALL BE SUFFICIENTLY COMPACTED AND OF SUCH MATERIAL TO PREVENT SEEPAGE.

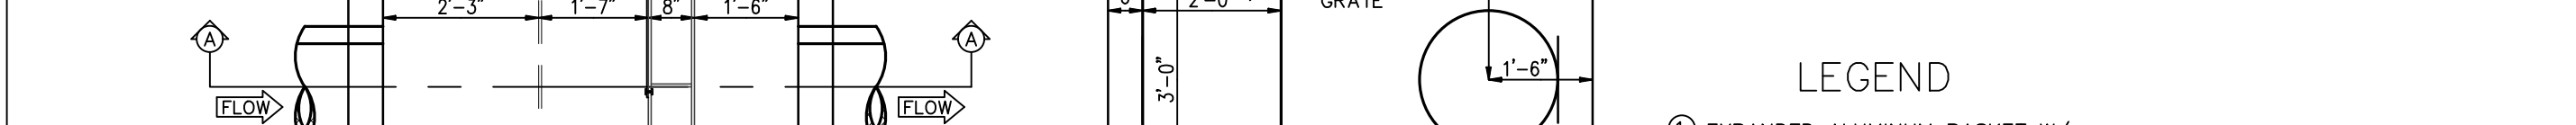

NOTES:
1. PRECAST CONCRETE MANHOLE WITH CONCRETE STRENGTH OF 4,000 PSI @ 28 DAYS.
2. THE DIPS OF ALL PIPES SHALL BE CUT OFF FLUSH WITH THE INSIDE SURFACE OF THE MANHOLE AND PARALLEL TO THE DRAINAGE DIRECTION.
3. PIPES SHALL BE PARALLEL TO INTERIOR AND EXTERIOR PRIOR TO BACKFILLING OF STRUCTURE. 4. CONCRETE STRUCTURE AND CASTING SHALL BE RATED FOR H2O TRAFFIC LOADING.
5. INLET FRAME SHALL BE FULLY SUPPORTED ON THE CONCRETE STRUCTURE FOR H2O LOADING.
6. MANHOLES WITH AN INTERIOR DEPTH OF 4' AND GREATER SHALL BE FURNISHED WITH STEEL REINFORCED POLYPROPYLENE PLASTIC STEPS AT 12" INTERVALS.



NOTES:
1. RIP RAP OUTLET PROTECTION SHALL BE 15" OF LIGHT STONE FILLING. STONE FILLING SIZE #50-60". RIVER ROCK MAY BE SUBSTITUTED FOR ANGULAR STONE.

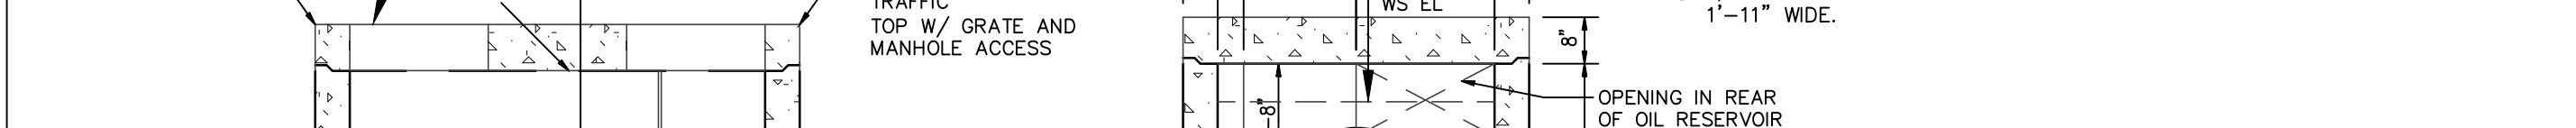


NOTES:
1. ALL TRASH RACKS SHALL HAVE UV PROTECTION MEETING OR EXCEEDING THE REQUIREMENTS OF ASTM D2565-99.
2. TRASH RACKS SHALL BE SECURED PER THE MANUFACTURER'S RECOMMENDATIONS.
3. WHERE HIGH FLOW ORIFICE EXTENDS TO TOP OF STRUCTURE, THE MAXIMUM ALLOWABLE GAP BETWEEN THE TRASH RACKS SHALL BE 4".



NOTES:
1. PROVIDE AN INSPECTION PORT FOR THE INITIAL AND FINAL CHAMBER OF EACH ROW, AND FOR ROWS WITH MORE THAN 4 CHAMBERS, ONE IN AN INTERMEDIATE CHAMBER.




NOTES:
1. TO BE PROVIDED AT INFILTRATION BASIN A.

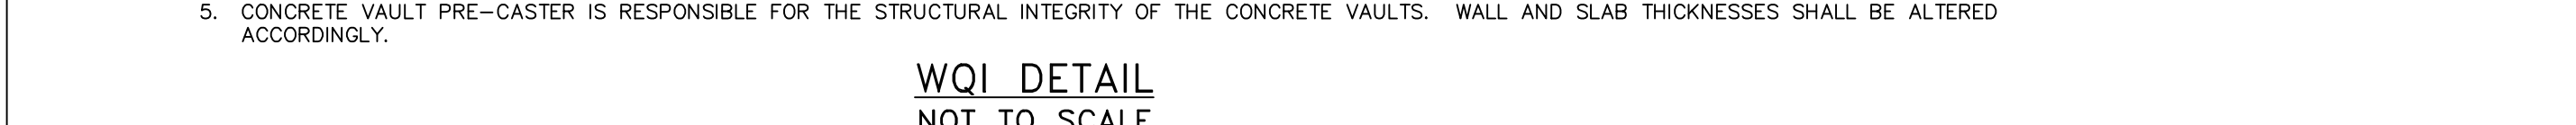


NOTES:
1. YARD INLET BASINS SHALL BE PRE-CAST REINFORCED CONCRETE. SHALL HAVE A MINIMUM 28-DAY COMPRESSIVE STRENGTH OF 4,000 PSI AND SHALL BE IN CONFORMANCE WITH ASTM 478-68. WALLS AND BASE SHALL BE ONE PIECE CONSTRUCTION. YARD INLET BASIN SHOWN BY EXPANDED SUPPLY PRODUCTS (ESP), 3330 ROUTE 8, COLD SPRING, NY (845) 265-3771.
2. BACKFILL USING SELECT MATERIAL, COMPACTED IN 6" LIFTS.
3. SUMP SHALL BE 12" MIN.
4. FRAMES AND GRATES SHALL BE SET IN A FULL BED OF MORTAR.



NOTES:
1. MINIMUM 1' DEPTH AND 1' WIDTH FOR ALL SWALES.
2. SWALE SHALL BE SEED WITH FAST GERMINATING RYE 15 TO 25 POUNDS PER 1,000 SQUARE FEET AND MULCHED.

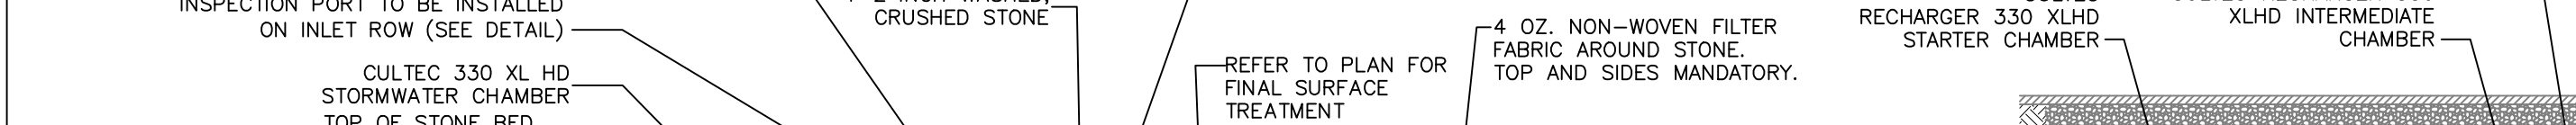


NOTES:
1. PRECAST CONCRETE MANHOLE WITH CONCRETE STRENGTH OF 4,000 PSI @ 28 DAYS.
2. THE DIPS OF ALL PIPES SHALL BE CUT OFF FLUSH WITH THE INSIDE SURFACE OF THE MANHOLE AND PARALLEL TO THE DRAINAGE DIRECTION.
3. PIPES SHALL BE PARALLEL TO INTERIOR AND EXTERIOR PRIOR TO BACKFILLING OF STRUCTURE. 4. CONCRETE STRUCTURE AND CASTING SHALL BE RATED FOR H2O TRAFFIC LOADING.
5. INLET FRAME SHALL BE FULLY SUPPORTED ON THE CONCRETE STRUCTURE FOR H2O LOADING.
6. MANHOLES WITH AN INTERIOR DEPTH OF 4' AND GREATER SHALL BE FURNISHED WITH STEEL REINFORCED POLYPROPYLENE PLASTIC STEPS AT 12" INTERVALS.

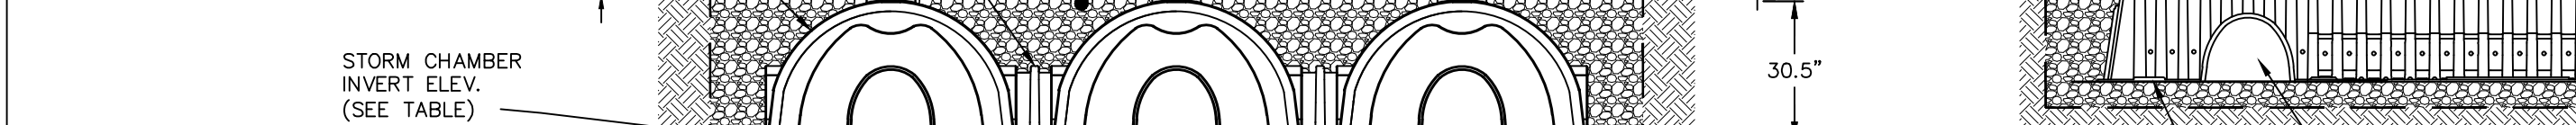


NOTES:
1. RIP RAP OUTLET PROTECTION SHALL BE 15" OF LIGHT STONE FILLING. STONE FILLING SIZE #50-60". RIVER ROCK MAY BE SUBSTITUTED FOR ANGULAR STONE.




NOTES:
1. ALL TRASH RACKS SHALL HAVE UV PROTECTION MEETING OR EXCEEDING THE REQUIREMENTS OF ASTM D2565-99.
2. TRASH RACKS SHALL BE SECURED PER THE MANUFACTURER'S RECOMMENDATIONS.
3. WHERE HIGH FLOW ORIFICE EXTENDS TO TOP OF STRUCTURE, THE MAXIMUM ALLOWABLE GAP BETWEEN THE TRASH RACKS SHALL BE 4".

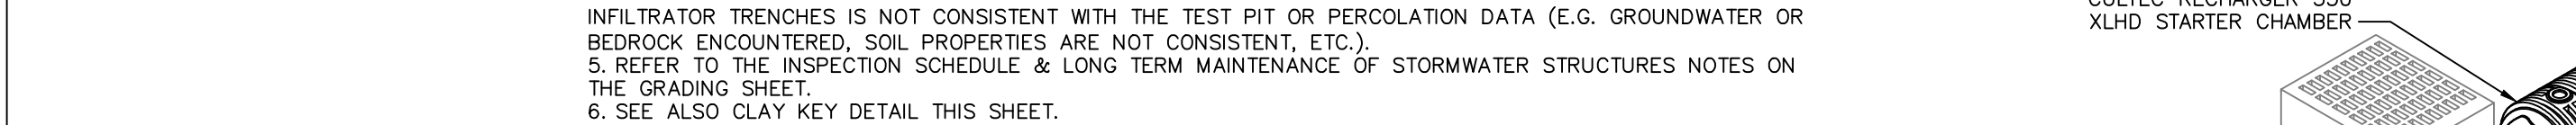


NOTES:
1. PROVIDE AN INSPECTION PORT FOR THE INITIAL AND FINAL CHAMBER OF EACH ROW, AND FOR ROWS WITH MORE THAN 4 CHAMBERS, ONE IN AN INTERMEDIATE CHAMBER.

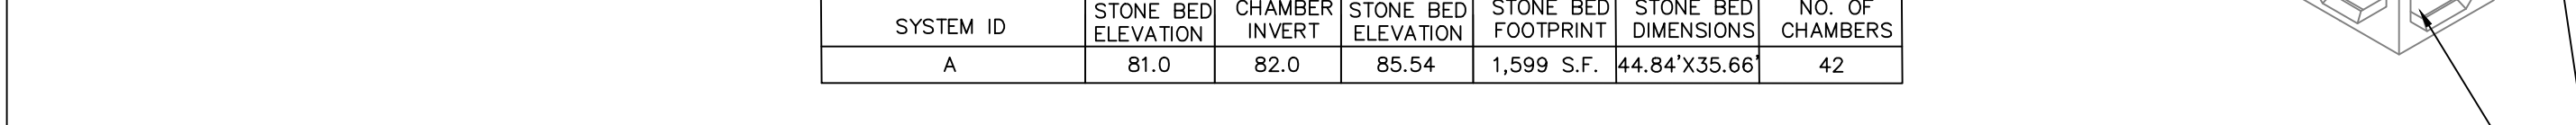


NOTES:
1. TO BE PROVIDED AT INFILTRATION BASIN A.

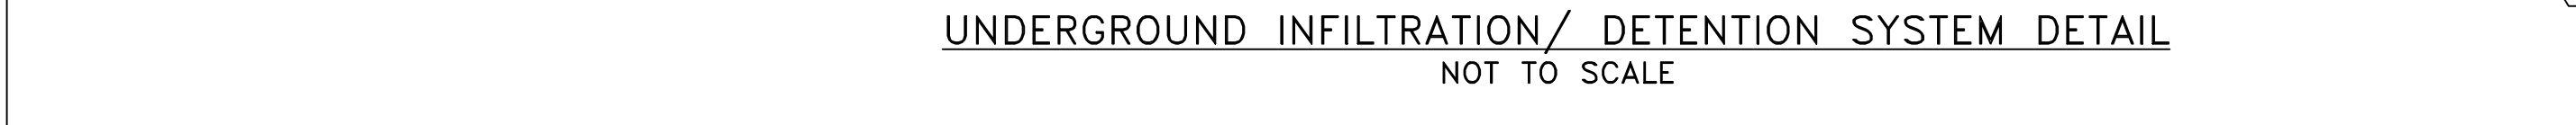


NOTES:
1. YARD INLET BASINS SHALL BE PRE-CAST REINFORCED CONCRETE. SHALL HAVE A MINIMUM 28-DAY COMPRESSIVE STRENGTH OF 4,000 PSI AND SHALL BE IN CONFORMANCE WITH ASTM 478-68. WALLS AND BASE SHALL BE ONE PIECE CONSTRUCTION. YARD INLET BASIN SHOWN BY EXPANDED SUPPLY PRODUCTS (ESP), 3330 ROUTE 8, COLD SPRING, NY (845) 265-3771.
2. BACKFILL USING SELECT MATERIAL, COMPACTED IN 6" LIFTS.
3. SUMP SHALL BE 12" MIN.
4. FRAMES AND GRATES SHALL BE SET IN A FULL BED OF MORTAR.

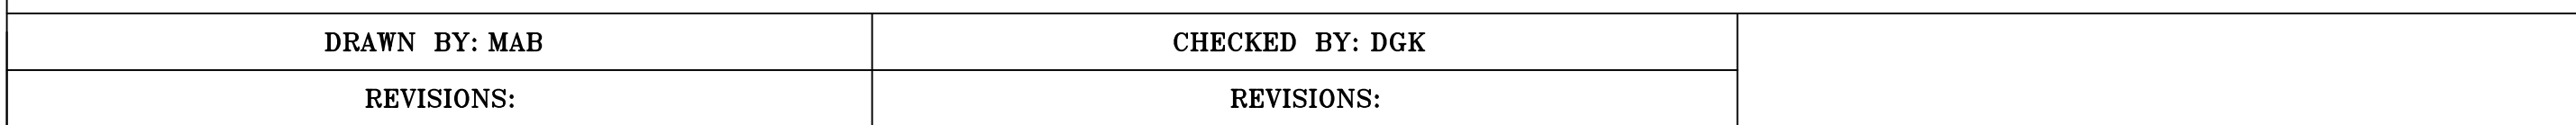


NOTES:
1. MINIMUM 1' DEPTH AND 1' WIDTH FOR ALL SWALES.
2. SWALE SHALL BE SEED WITH FAST GERMINATING RYE 15 TO 25 POUNDS PER 1,000 SQUARE FEET AND MULCHED.

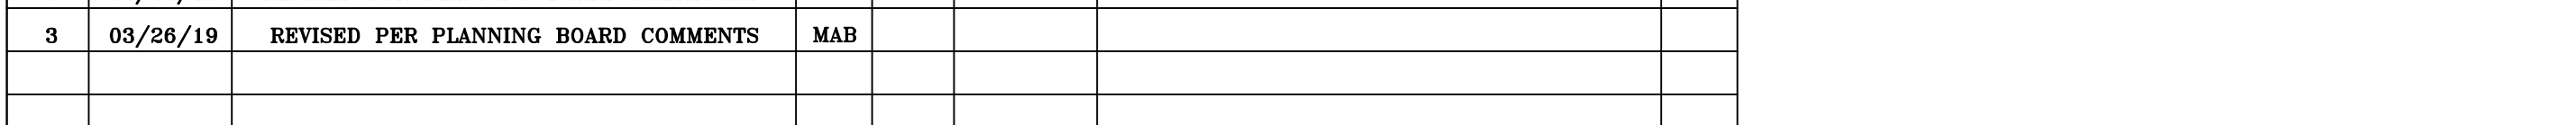

NOTES:
1. PRECAST CONCRETE MANHOLE WITH CONCRETE STRENGTH OF 4,000 PSI @ 28 DAYS.
2. THE DIPS OF ALL PIPES SHALL BE CUT OFF FLUSH WITH THE INSIDE SURFACE OF THE MANHOLE AND PARALLEL TO THE DRAINAGE DIRECTION.
3. PIPES SHALL BE PARALLEL TO INTERIOR AND EXTERIOR PRIOR TO BACKFILLING OF STRUCTURE. 4. CONCRETE STRUCTURE AND CASTING SHALL BE RATED FOR H2O TRAFFIC LOADING.
5. INLET FRAME SHALL BE FULLY SUPPORTED ON THE CONCRETE STRUCTURE FOR H2O LOADING.
6. MANHOLES WITH AN INTERIOR DEPTH OF 4' AND GREATER SHALL BE FURNISHED WITH STEEL REINFORCED POLYPROPYLENE PLASTIC STEPS AT 12" INTERVALS.

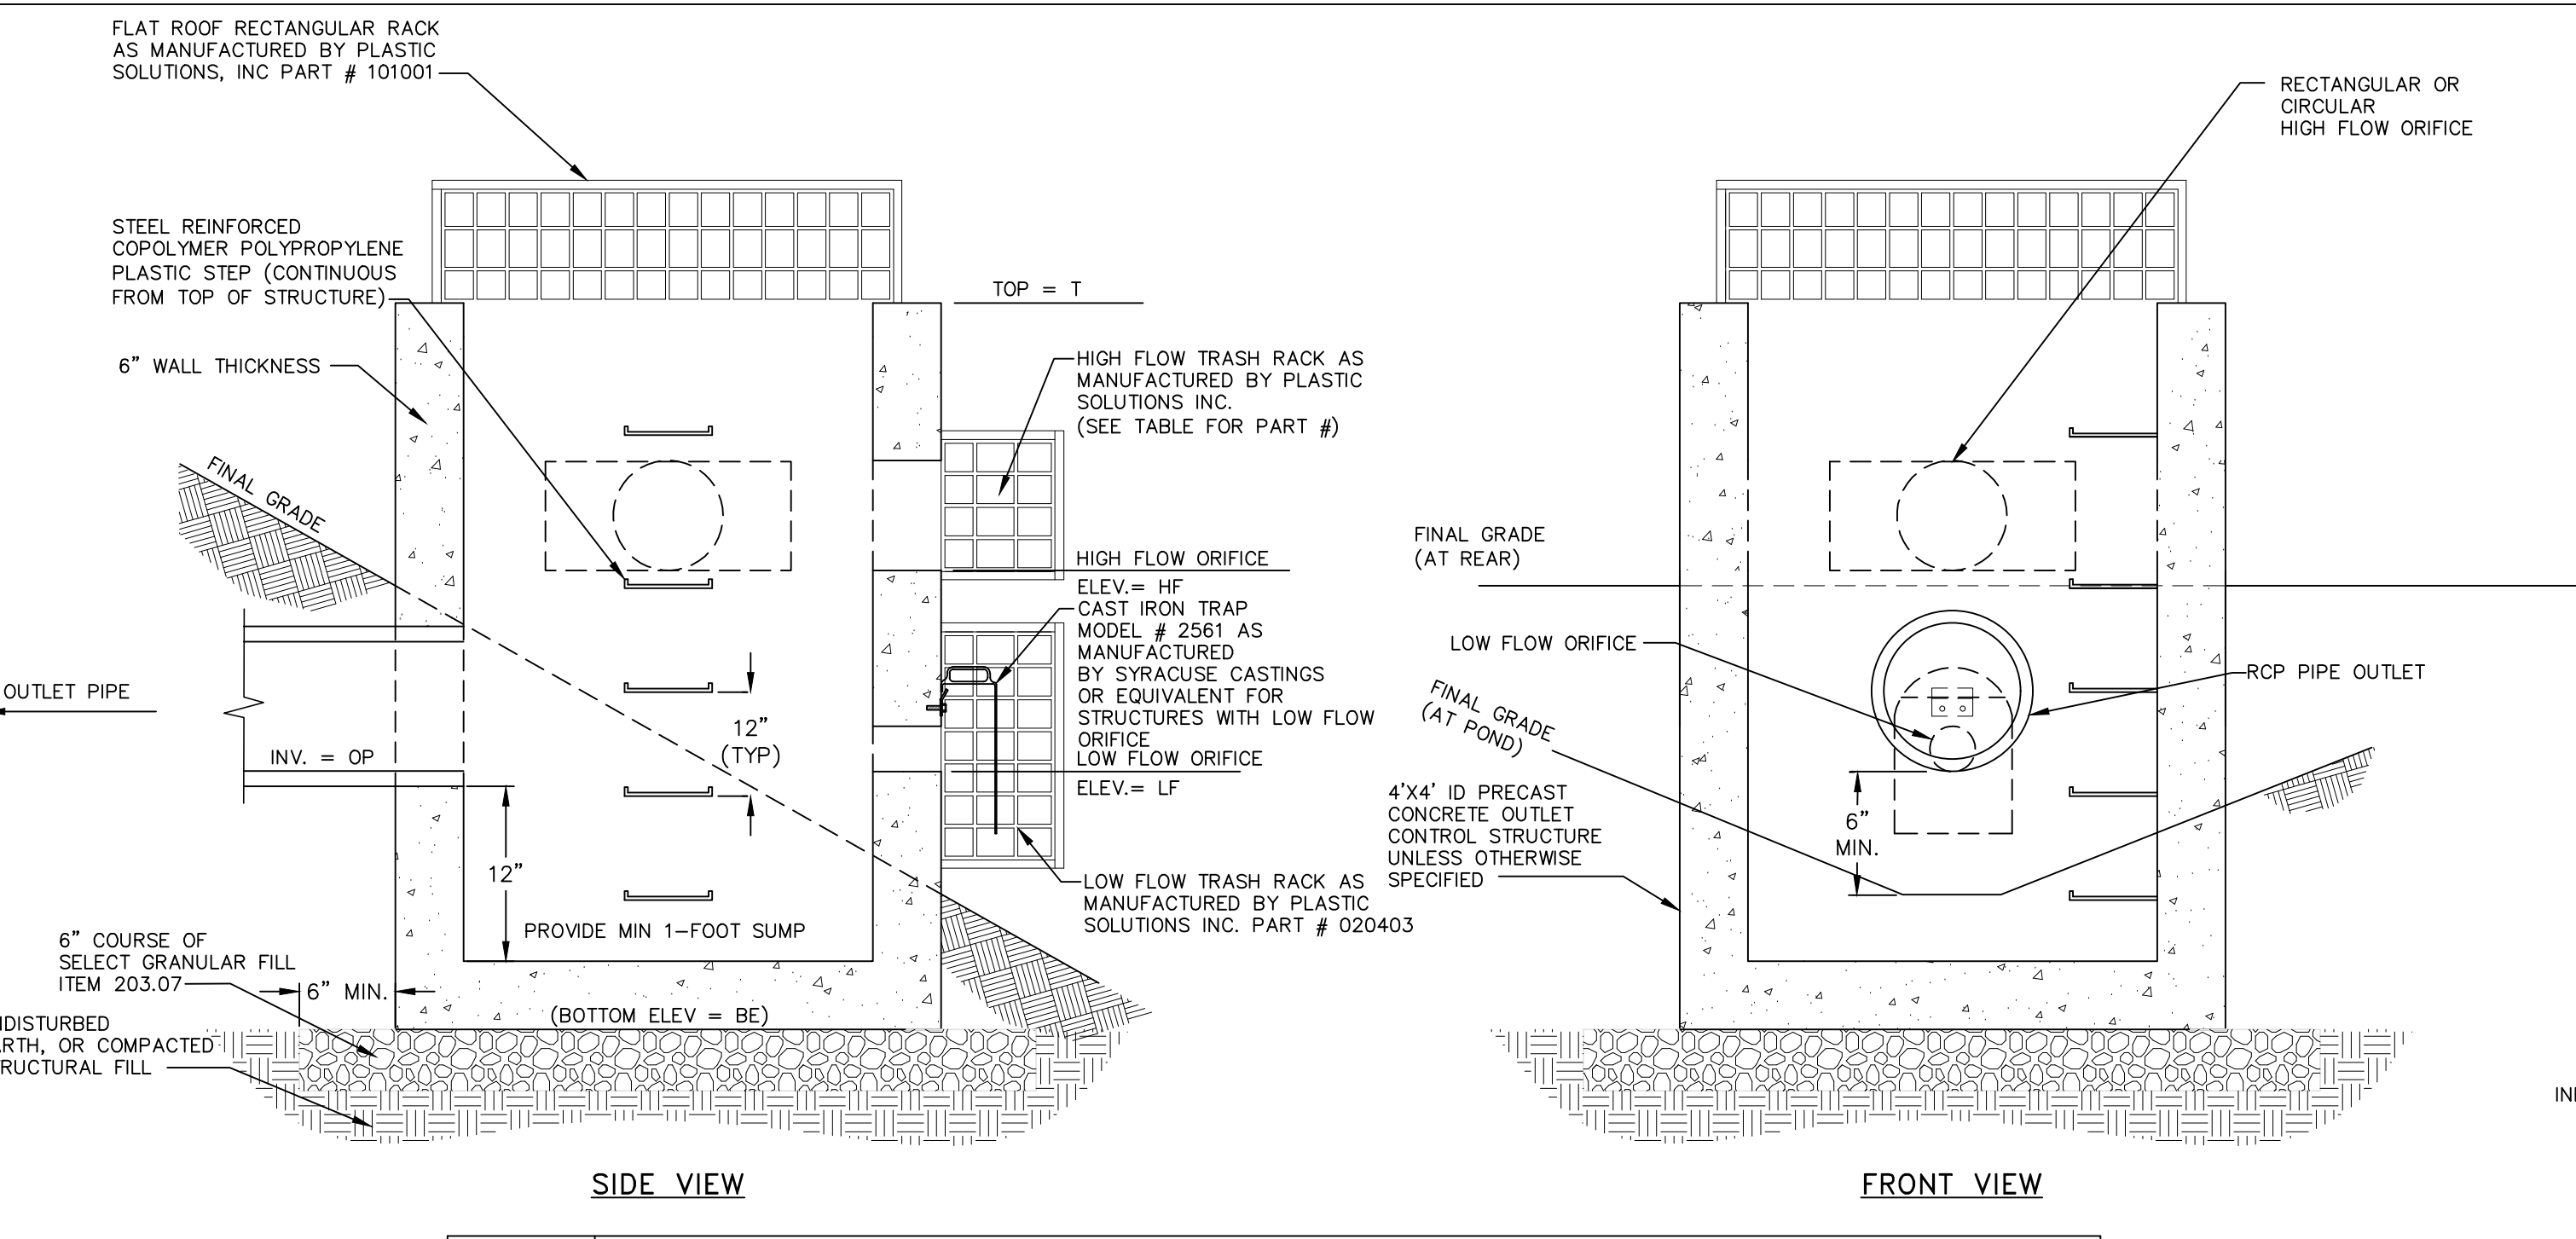

NOTES:
1. EXCAVATION AND TRENCHING SHALL MEET ALL OSHA REQUIREMENTS.
2. BACKFILL SHALL BE COMPACTED TO 95% STANDARD PROCTOR IN 6" LIFTS MAXIMUM.
3. HIGH DENSITY POLYETHYLENE PIPE - SIZE PER PLAN.
4. 1.5" DIAMETER MAX GRAVEL OR CRUSHED STONE.
5. SUTABLE RUN OF TRENCH IN 6" MAX. COMPACTED LIFTS - OUTSIDE OF ROADWAY AND ROAD.
6. RIGHT-OF-WAY ONLY (SEE NOTE 2 BELOW). INNER ROADWAY AND RIGHT-OF-WAY MATERIAL SHALL BE NYSDOT ITEM 304.12.

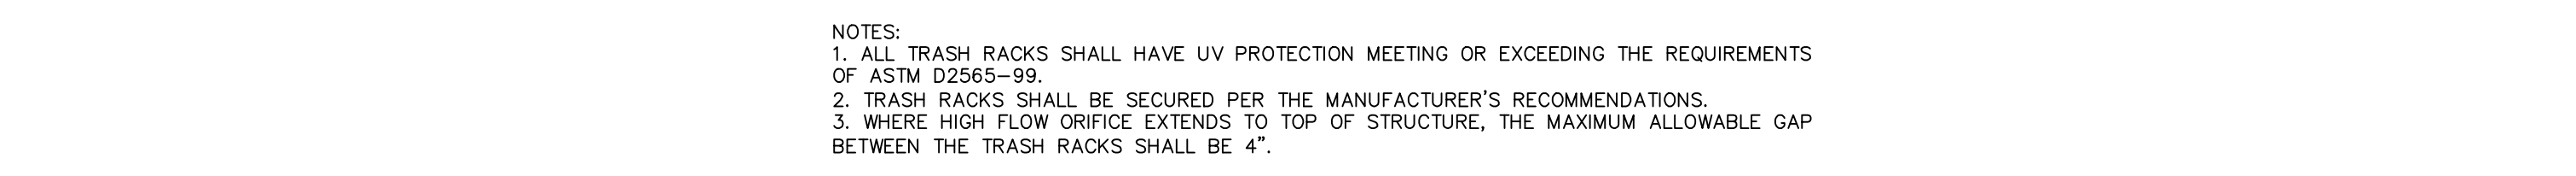


NOTES:
1. HEAVY DUTY RECTANGULAR STORMWATER INLET GRATE TO BE CAMPBELL FOUNDRY MODEL 2241, OR APPROVED EQUAL.
2. CATCH BASINS TO RECEIVE CURB INLETS ARE: CB 104, CB 301, CB 301A, CB 302, CB 303, CB 304, AND CB 305.
3. HOPE PIPE SHALL BE PROVIDED WITH WATER TIGHT CONNECTIONS. ADS MODEL N12 W/B OR APPROVED EQUAL.



NOTES:
1. ALL TRASH RACKS SHALL HAVE UV PROTECTION MEETING OR EXCEEDING THE REQUIREMENTS OF ASTM D2565-99.
2. TRASH RACKS SHALL BE SECURED PER THE MANUFACTURER'S RECOMMENDATIONS.
3. WHERE HIGH FLOW ORIFICE EXTENDS TO TOP OF STRUCTURE, THE MAXIMUM ALLOWABLE GAP BETWEEN THE TRASH RACKS SHALL BE 4".



NOTES:
1. THE INFILTRATION BASIN SHALL NOT SERVE AS A SEDIMENT TRAP DURING CONSTRUCTION AND SHALL BE PROTECTED FROM CONSTRUCTION ACTIVITY.
2. RELATIVELY LIGHT TRACKED EQUIPMENT IS RECOMMENDED FOR CONSTRUCTION PURPOSES TO AVOID COMPACTION OF THE BASIN FLOOR.
3. A HIGHLY POROUS SURFACE TEXTURE SHALL BE RETAINED ALONG THE BASIN FLOOR, ESPECIALLY WITHIN THE AREA IDENTIFIED AS BEING USED FOR INFILTRATION.
4. ESTABLISH DENSE VEGETATION ON THE BASIN SIDE SLOPES AND FLOOR TO PREVENT EROSION AND SLOUGHING AND TO PROVIDE A NATURAL MEANS OF MAINTAINING RELATIVELY HIGH INFILTRATION RATES. GRASSES OF THE FESCUE FAMILY (ALTA FESCUE, WESTERN FESCUE OR RED FESCUE) ARE SPECIFIED ON THIS PLAN, PRIMARILY DUE TO THEIR ADAPTABILITY TO DRY SANDY SOILS, DROUGHT RESISTANCE, HARDINESS, AND ABILITY TO WITHSTAND BRIEF INUNDATIONS. FESCUE WILL ALSO ALLOW FOR LONG INTERVALS BETWEEN MOWINGS, WHICH SHALL OCCUR TWICE PER YEAR MINIMUM, TYPICALLY IN JUNE AND SEPTEMBER IS SATISFACTORY.
5. THE BERMS SHALL BE SUFFICIENTLY COMPACTED AND OF SUCH MATERIAL TO PREVENT SEEPAGE.

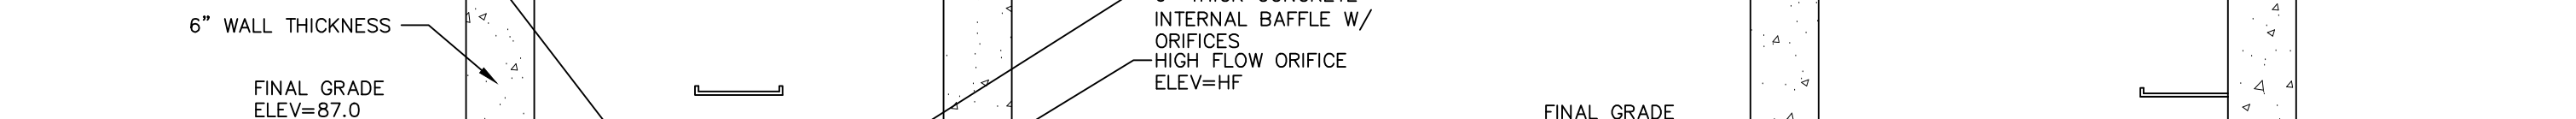

NOTES:
1. PRECAST CONCRETE MANHOLE WITH CONCRETE STRENGTH OF 4,000 PSI @ 28 DAYS.
2. THE DIPS OF ALL PIPES SHALL BE CUT OFF FLUSH WITH THE INSIDE SURFACE OF THE MANHOLE AND PARALLEL TO THE DRAINAGE DIRECTION.
3. PIPES SHALL BE PARALLEL TO INTERIOR AND EXTERIOR PRIOR TO BACKFILLING OF STRUCTURE. 4. CONCRETE STRUCTURE AND CASTING SHALL BE RATED FOR H2O TRAFFIC LOADING.
5. INLET FRAME SHALL BE FULLY SUPPORTED ON THE CONCRETE STRUCTURE FOR H2O LOADING.
6. MANHOLES WITH AN INTERIOR DEPTH OF 4' AND GREATER SHALL BE FURNISHED WITH STEEL REINFORCED POLYPROPYLENE PLASTIC STEPS AT 12" INTERVALS.




NOTES:
1. RIP RAP OUTLET PROTECTION SHALL BE 15" OF LIGHT STONE FILLING. STONE FILLING SIZE #50-60". RIVER ROCK MAY BE SUBSTITUTED FOR ANGULAR STONE.




NOTES:
1. ALL TRASH RACKS SHALL HAVE UV PROTECTION MEETING OR EXCEEDING THE REQUIREMENTS OF ASTM D2565-99.
2. TRASH RACKS SHALL BE SECURED PER THE MANUFACTURER'S RECOMMENDATIONS.
3. WHERE HIGH FLOW ORIFICE EXTENDS TO TOP OF STRUCTURE, THE MAXIMUM ALLOWABLE GAP BETWEEN THE TRASH RACKS SHALL BE 4".



NOTES:
1. PROVIDE AN INSPECTION PORT FOR THE INITIAL AND FINAL CHAMBER OF EACH ROW, AND FOR ROWS WITH MORE THAN 4 CHAMBERS, ONE IN AN INTERMEDIATE CHAMBER.

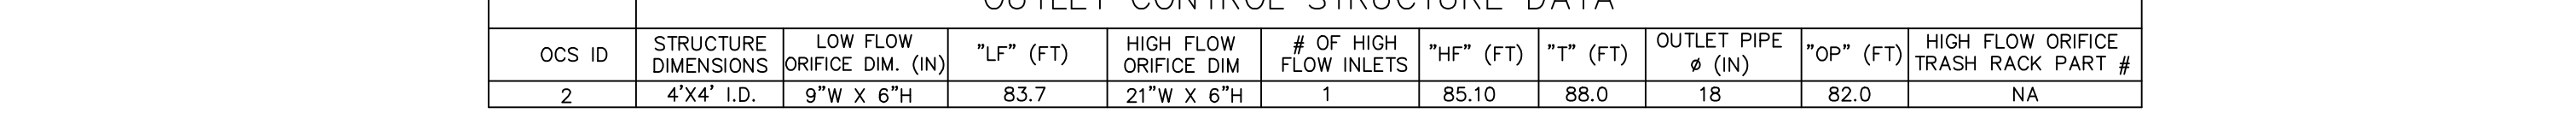

NOTES:
1. TO BE PROVIDED AT INFILTRATION BASIN A.

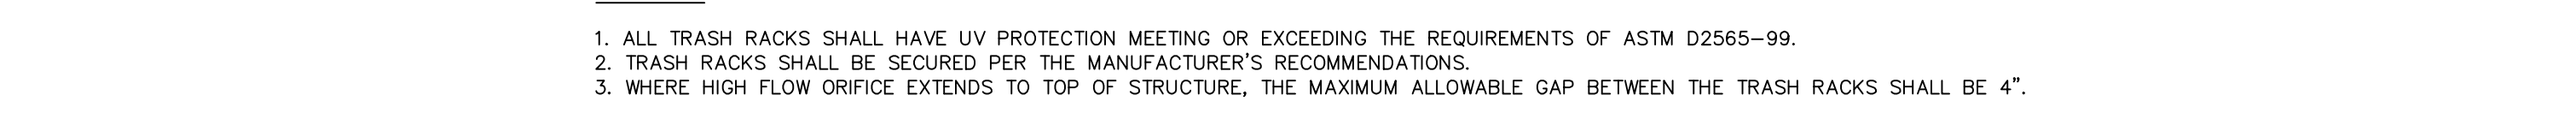

NOTES:
1. YARD INLET BASINS SHALL BE PRE-CAST REINFORCED CONCRETE. SHALL HAVE A MINIMUM 28-DAY COMPRESSIVE STRENGTH OF 4,000 PSI AND SHALL BE IN CONFORMANCE WITH ASTM 478-68. WALLS AND BASE SHALL BE ONE PIECE CONSTRUCTION. YARD INLET BASIN SHOWN BY EXPANDED SUPPLY PRODUCTS (ESP), 3330 ROUTE 8, COLD SPRING, NY (845) 265-3771.
2. BACKFILL USING SELECT MATERIAL, COMPACTED IN 6" LIFTS.
3. SUMP SHALL BE 12" MIN.
4. FRAMES AND GRATES SHALL BE SET IN A FULL BED OF MORTAR.




NOTES:
1. MINIMUM 1' DEPTH AND 1' WIDTH FOR ALL SWALES.
2. SWALE SHALL BE SEED WITH FAST GERMINATING RYE 15 TO 25 POUNDS PER 1,000 SQUARE FEET AND MULCHED.




NOTES:
1. PRECAST CONCRETE MANHOLE WITH CONCRETE STRENGTH OF 4,000 PSI @ 28 DAYS.
2. THE DIPS OF ALL PIPES SHALL BE CUT OFF FLUSH WITH THE INSIDE SURFACE OF THE MANHOLE AND PARALLEL TO THE DRAINAGE DIRECTION.
3. PIPES SHALL BE PARALLEL TO INTERIOR AND EXTERIOR PRIOR TO BACKFILLING OF STRUCTURE. 4. CONCRETE STRUCTURE AND CASTING SHALL BE RATED FOR H2O TRAFFIC LOADING.
5. INLET FRAME SHALL BE FULLY SUPPORTED ON THE CONCRETE STRUCTURE FOR H2O LOADING.
6. MANHOLES WITH AN INTERIOR DEPTH OF 4' AND GREATER SHALL BE FURNISHED WITH STEEL REINFORCED POLYPROPYLENE PLASTIC STEPS AT 12" INTERVALS.




NOTES:
1. RIP RAP OUTLET PROTECTION SHALL BE 15" OF LIGHT STONE FILLING. STONE FILLING SIZE #50-60". RIVER ROCK MAY BE SUBSTITUTED FOR ANGULAR STONE.

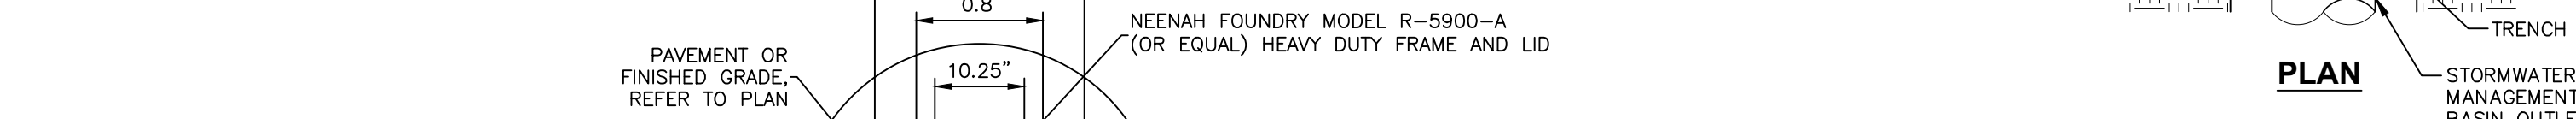

NOTES:
1. ALL TRASH RACKS SHALL HAVE UV PROTECTION MEETING OR EXCEEDING THE REQUIREMENTS OF ASTM D2565-99.
2. TRASH RACKS SHALL BE SECURED PER THE MANUFACTURER'S RECOMMENDATIONS.
3. WHERE HIGH FLOW ORIFICE EXTENDS TO TOP OF STRUCTURE, THE MAXIMUM ALLOWABLE GAP BETWEEN THE TRASH RACKS SHALL BE 4".

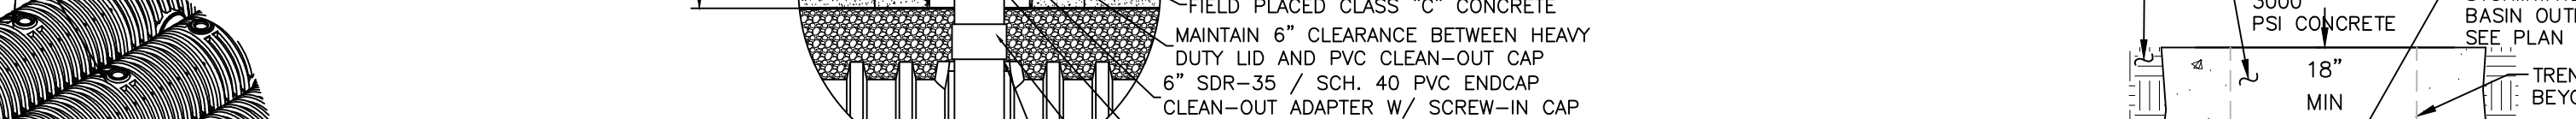

NOTES:
1. PROVIDE AN INSPECTION PORT FOR THE INITIAL AND FINAL CHAMBER OF EACH ROW, AND FOR ROWS WITH MORE THAN 4 CHAMBERS, ONE IN AN INTERMEDIATE CHAMBER.

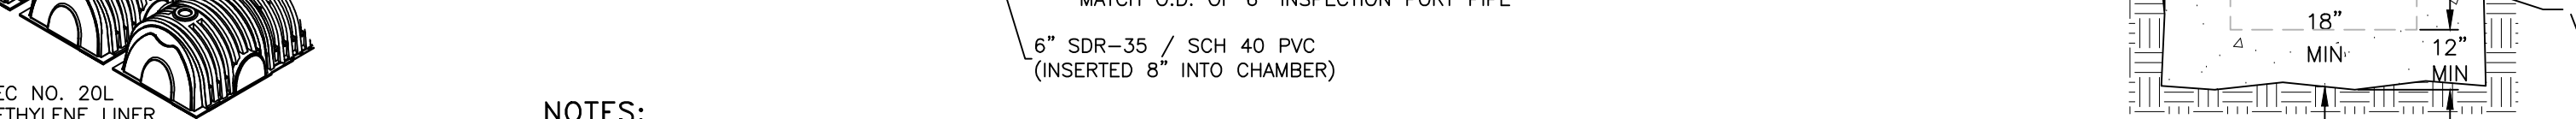

NOTES:
1. TO BE PROVIDED AT INFILTRATION BASIN A.




NOTES:
1. YARD INLET BASINS SHALL BE PRE-CAST REINFORCED CONCRETE. SHALL HAVE A MINIMUM 28-DAY COMPRESSIVE STRENGTH OF 4,000 PSI AND SHALL BE IN CONFORMANCE WITH ASTM 478-68. WALLS AND BASE SHALL BE ONE PIECE CONSTRUCTION. YARD INLET BASIN SHOWN BY EXPANDED SUPPLY PRODUCTS (ESP), 3330 ROUTE 8, COLD SPRING, NY (845) 265-3771.
2. BACKFILL USING SELECT MATERIAL, COMPACTED IN 6" LIFTS.
3. SUMP SHALL BE 12" MIN.
4. FRAMES AND GRATES SHALL BE SET IN A FULL BED OF MORTAR.



NOTES:
1. MINIMUM 1' DEPTH AND 1' WIDTH FOR ALL SWALES.
2. SWALE SHALL BE SEED WITH FAST GERMINATING RYE 15 TO 25 POUNDS PER 1,000 SQUARE FEET AND MULCHED.



NOTES:
1. PRECAST CONCRETE MANHOLE WITH CONCRETE STRENGTH OF 4,000 PSI @ 28 DAYS.
2. THE DIPS OF ALL PIPES SHALL BE CUT OFF FLUSH WITH THE INSIDE SURFACE OF THE MANHOLE AND PARALLEL TO THE DRAINAGE DIRECTION.
3. PIPES SHALL BE PARALLEL TO INTERIOR AND EXTERIOR PRIOR TO BACKFILLING OF STRUCTURE. 4. CONCRETE STRUCTURE AND CASTING SHALL BE RATED FOR H2O TRAFFIC LOADING.
5. INLET FRAME SHALL BE FULLY SUPPORTED ON THE CONCRETE STRUCTURE FOR H2O LOADING.
6. MANHOLES WITH AN INTERIOR DEPTH OF 4' AND GREATER SHALL BE FURNISHED WITH STEEL REINFORCED POLYPROPYLENE PLASTIC STEPS AT 12" INTERVALS.

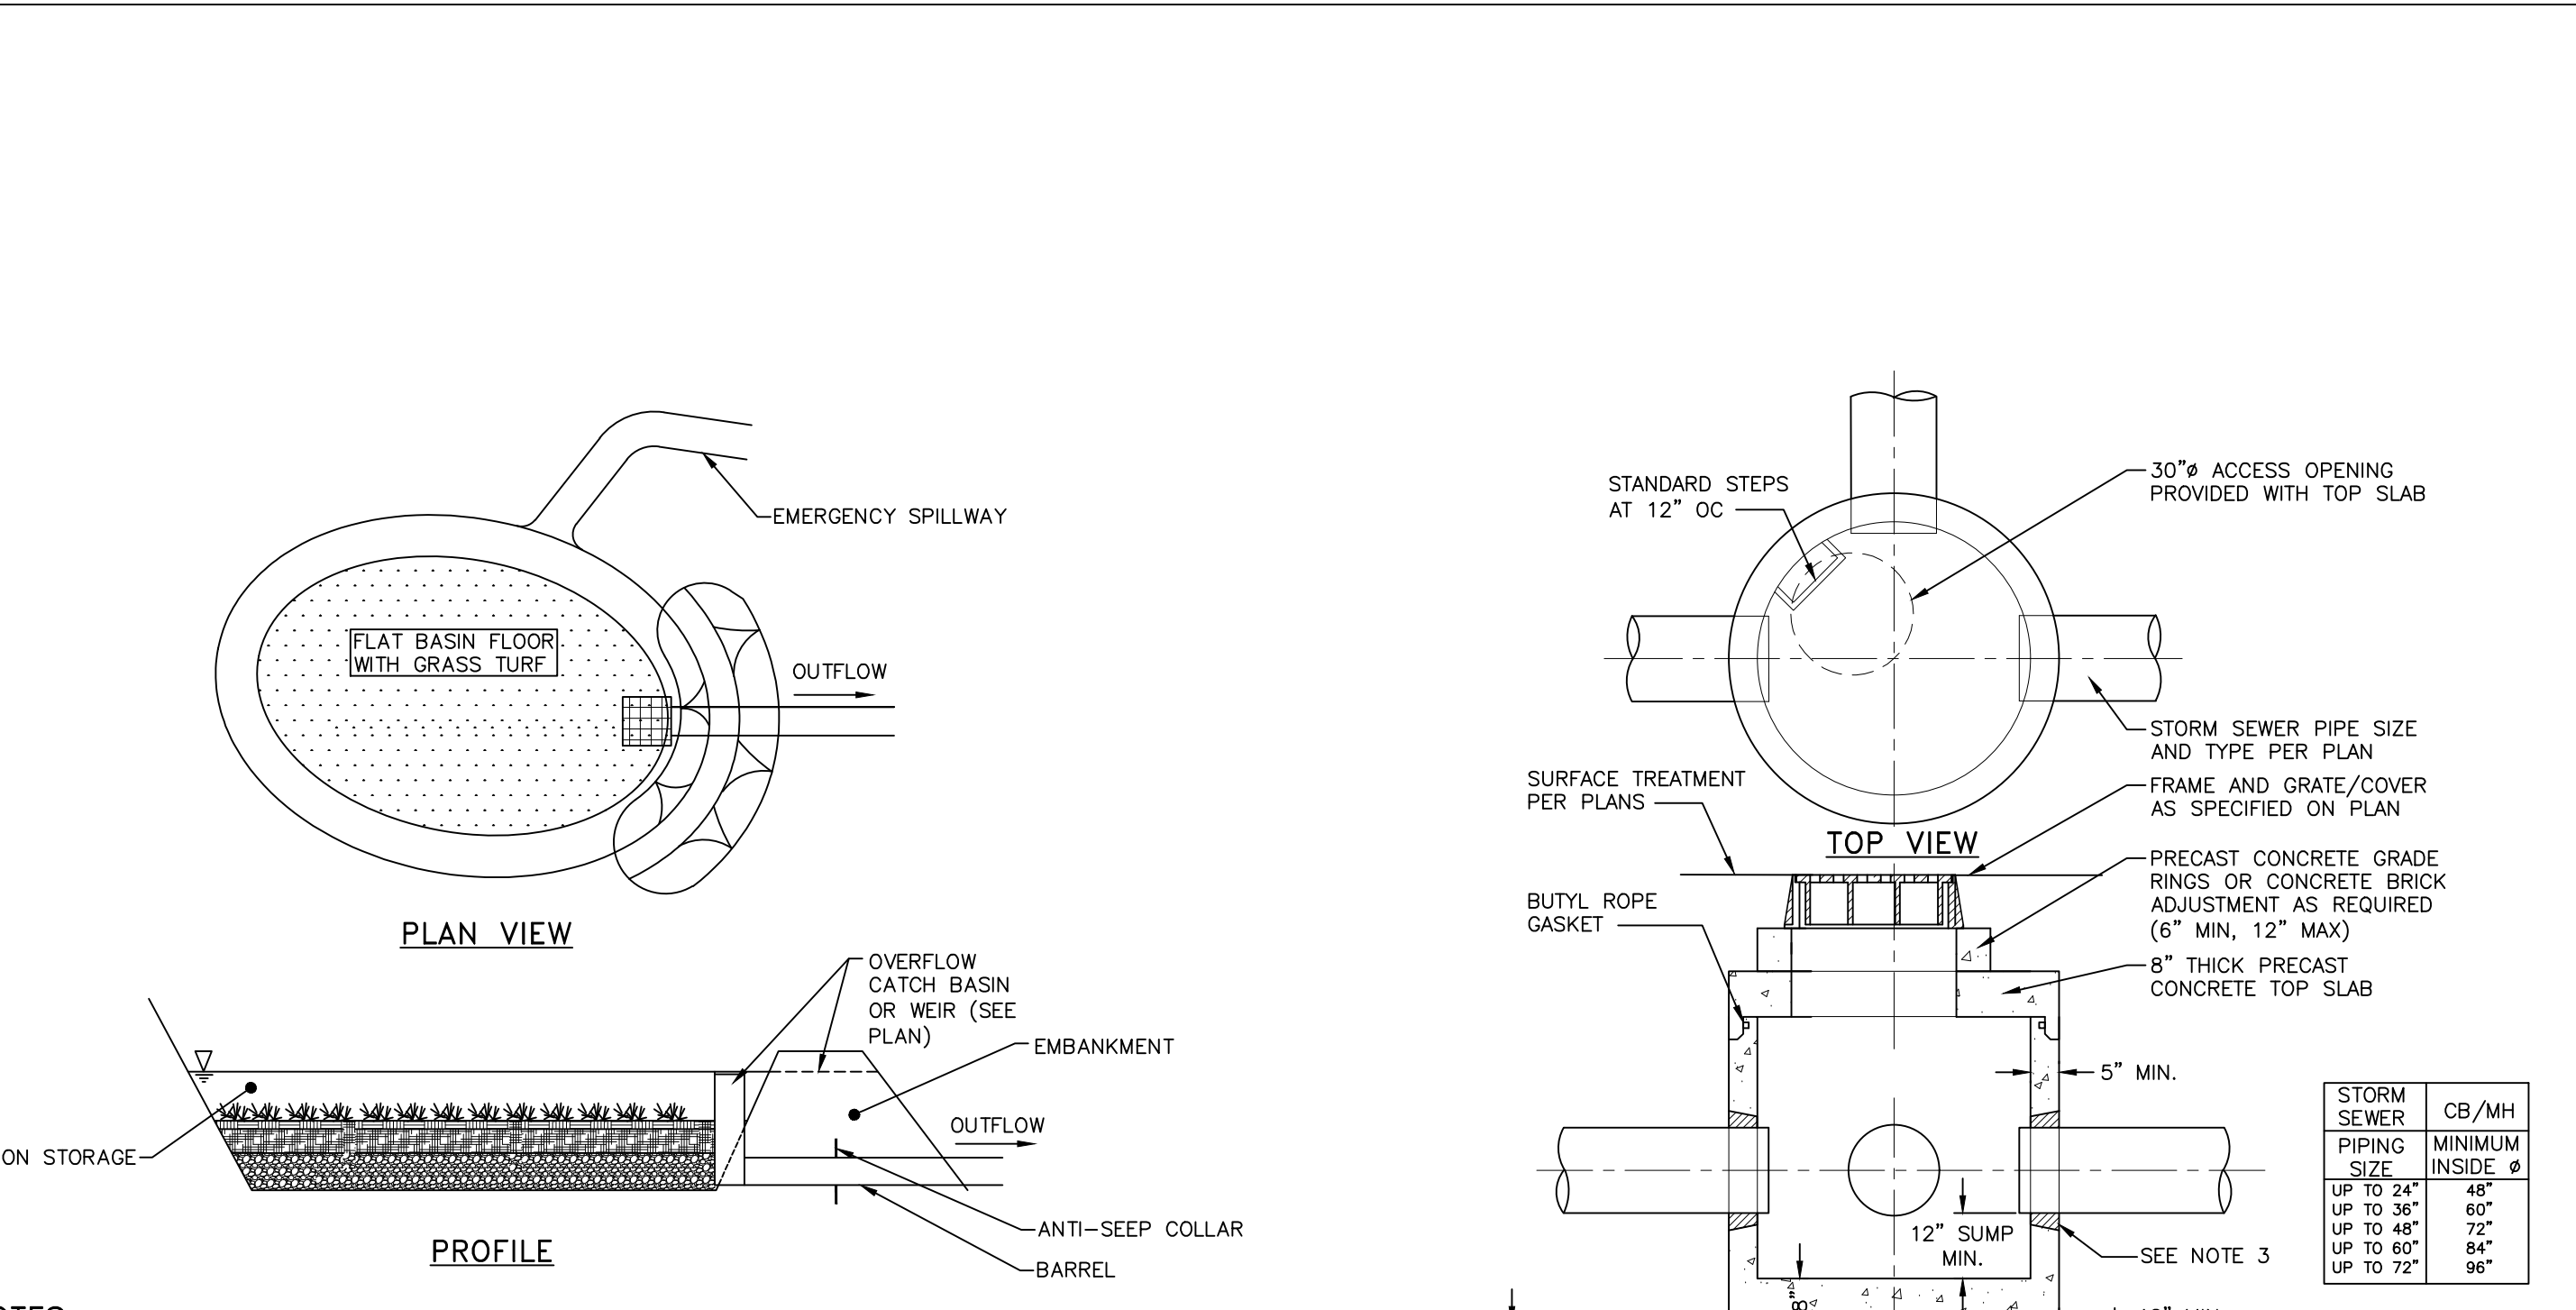


NOTES:
1. EXCAVATION AND TRENCHING SHALL MEET ALL OSHA REQUIREMENTS.
2. BACKFILL SHALL BE COMPACTED TO 95% STANDARD PROCTOR IN 6" LIFTS MAXIMUM.
3. HIGH DENSITY POLYETHYLENE PIPE - SIZE PER PLAN.
4. 1.5" DIAMETER MAX GRAVEL OR CRUSHED STONE.
5. SUTABLE RUN OF TRENCH IN 6" MAX. COMPACTED LIFTS - OUTSIDE OF ROADWAY AND ROAD.
6. RIGHT-OF-WAY ONLY (SEE NOTE 2 BELOW). INNER ROADWAY AND RIGHT-OF-WAY MATERIAL SHALL BE NYSDOT ITEM 304.12.



NOTES:
1. HEAVY DUTY RECTANGULAR STORMWATER INLET GRATE TO BE CAMPBELL FOUNDRY MODEL 2241, OR APPROVED EQUAL.
2. CATCH BASINS TO RECEIVE CURB INLETS ARE: CB 104, CB 301, CB 301A, CB 302, CB 303, CB 304, AND CB 305.
3. HOPE PIPE SHALL BE PROVIDED WITH WATER TIGHT CONNECTIONS. ADS MODEL N12 W/B OR APPROVED EQUAL.




NOTES:
1. ALL TRASH RACKS SHALL HAVE UV PROTECTION MEETING OR EXCEEDING THE REQUIREMENTS OF ASTM D2565-99.
2. TRASH RACKS SHALL BE SECURED PER THE MANUFACTURER'S RECOMMENDATIONS.
3. WHERE HIGH FLOW ORIFICE EXTENDS TO TOP OF STRUCTURE, THE MAXIMUM ALLOWABLE GAP BETWEEN THE TRASH RACKS SHALL BE 4".

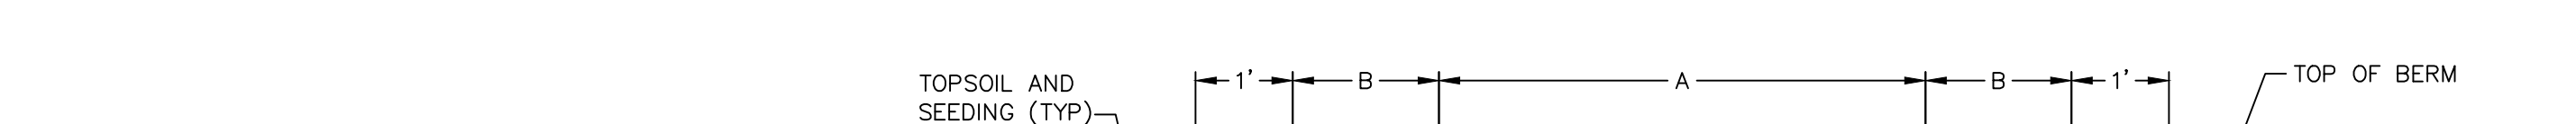


NOTES:
1. THE INFILTRATION BASIN SHALL NOT SERVE AS A SEDIMENT TRAP DURING CONSTRUCTION AND SHALL BE PROTECTED FROM CONSTRUCTION ACTIVITY.
2. RELATIVELY LIGHT TRACKED EQUIPMENT IS RECOMMENDED FOR CONSTRUCTION PURPOSES TO AVOID COMPACTION OF THE BASIN FLOOR.
3. A HIGHLY POROUS SURFACE TEXTURE SHALL BE RETAINED ALONG THE BASIN FLOOR, ESPECIALLY WITHIN THE AREA IDENTIFIED AS BEING USED FOR INFILTRATION.
4. ESTABLISH DENSE VEGETATION ON THE BASIN SIDE SLOPES AND FLOOR TO PREVENT EROSION AND SLOUGHING AND TO PROVIDE A NATURAL MEANS OF MAINTAINING RELATIVELY HIGH INFILTRATION RATES. GRASSES OF THE FESCUE FAMILY (ALTA FESCUE, WESTERN FESCUE OR RED FESCUE) ARE SPECIFIED ON THIS PLAN, PRIMARILY DUE TO THEIR ADAPTABILITY TO DRY SANDY SOILS, DROUGHT RESISTANCE, HARDINESS, AND ABILITY TO WITHSTAND BRIEF INUNDATIONS. FESCUE WILL ALSO ALLOW FOR LONG INTERVALS BETWEEN MOWINGS, WHICH SHALL OCCUR TWICE PER YEAR MINIMUM, TYPICALLY IN JUNE AND SEPTEMBER IS SATISFACTORY.
5. THE BERMS SHALL BE SUFFICIENTLY COMPACTED AND OF SUCH MATERIAL TO PREVENT SEEPAGE.



NOTES:
1. PRECAST CONCRETE MANHOLE WITH CONCRETE STRENGTH OF 4,000 PSI @ 28 DAYS.
2. THE DIPS OF ALL PIPES SHALL BE CUT OFF FLUSH WITH THE INSIDE SURFACE OF THE MANHOLE AND PARALLEL TO THE DRAINAGE DIRECTION.
3. PIPES SHALL BE PARALLEL TO INTERIOR AND EXTERIOR PRIOR TO BACKFILLING OF STRUCTURE. 4. CONCRETE STRUCTURE AND CASTING SHALL BE RATED FOR H2O TRAFFIC LOADING.
5. INLET FRAME SHALL BE FULLY SUPPORTED ON THE CONCRETE STRUCTURE FOR H2O LOADING.
6. MANHOLES WITH AN INTERIOR DEPTH OF 4' AND GREATER SHALL BE FURNISHED WITH STEEL REINFORCED POLYPROPYLENE PLASTIC STEPS AT 12" INTERVALS.

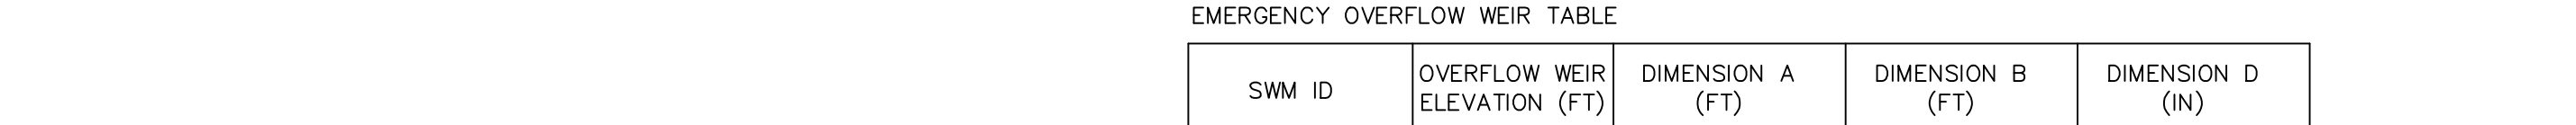

NOTES:
1. RIP RAP OUTLET PROTECTION SHALL BE 15" OF LIGHT STONE FILLING. STONE FILLING SIZE #50-60". RIVER ROCK MAY BE SUBSTITUTED FOR ANGULAR STONE.

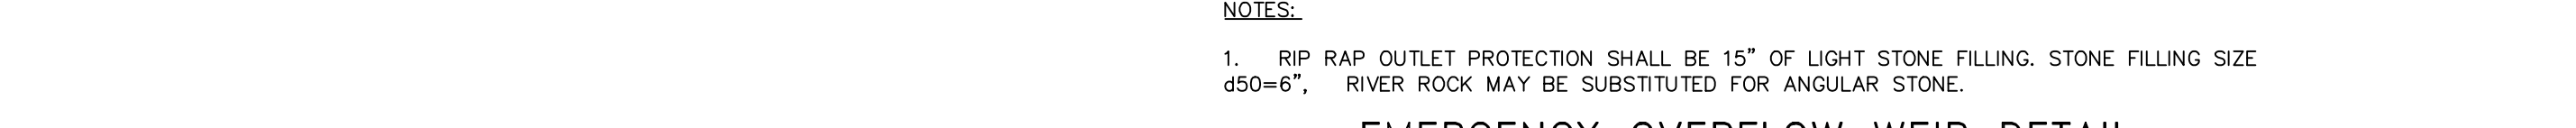

NOTES:
1. ALL TRASH RACKS SHALL HAVE UV PROTECTION MEETING OR EXCEEDING THE REQUIREMENTS OF ASTM D2565-99.
2. TRASH RACKS SHALL BE SECURED PER THE MANUFACTURER'S RECOMMENDATIONS.
3. WHERE HIGH FLOW ORIFICE EXTENDS TO TOP OF STRUCTURE, THE MAXIMUM ALLOWABLE GAP BETWEEN THE TRASH RACKS SHALL BE 4".

