


**UTILITY PLAN NOTES:**

- GENERAL CONSTRUCTION:**
1. ALL UNDERGROUND UTILITIES ARE SHOWN IN THEIR RELATIVE POSITION AND ARE FOR INFORMATIONAL PURPOSES ONLY. CONTRACTOR TO VERIFY THEIR ACTUAL LOCATION IN THE FIELD PRIOR TO THE COMMENCEMENT OF CONSTRUCTION.
  2. ANY CONDITION ENCOUNTERED IN THE FIELD DIFFERING FROM THOSE SHOWN HEREON, SHALL BE REPORTED TO THE DESIGN ENGINEER BEFORE CONSTRUCTION IS TO PROCEED.
  3. SEWER MAINS IN RELATION TO WATER MAINS, WHERE POSSIBLE, SEWERS SHALL BE LAD AT LEAST 10 (TEN) FEET HORIZONTALLY FROM ANY EXISTING OR PROPOSED WATER MAIN. VERTICAL SEPARATION SHALL BE MAINTAINED TO PROVIDE 18 (EIGHTEEN) INCHES BETWEEN TOP OF SEWER AND BOTTOM OF THE WATER MAIN AT UTILITY CROSSINGS. WHEN NOT POSSIBLE TO OBTAIN THE PROPER VERTICAL SEPARATION, SEWER PIPE SHALL BE PRESSURE RATED AND TESTED @ 150PSI, (10 TO 10) FEET ON EACH SIDE OF THE WATER MAIN BEING CROSSED.
  4. ALL PROPOSED UTILITIES SHALL TERMINATE 5 FEET FROM ANY PROPOSED BUILDING FACE. CONTRACTOR TO COORDINATE WITH BUILDING PLANS FOR ANY CONNECTIONS.
  5. ALL STORM SEWER SHALL BE SMOOTH INTERIOR HDPE UNLESS OTHERWISE SPECIFIED.
  6. ALL GRAVITY SANITARY LATERALS SHALL BE SDR 21 PVC UNLESS OTHERWISE SPECIFIED.
  7. ALL WATER PIPE SHALL BE CL52 DUCTILE IRON PIPE UNLESS OTHERWISE SPECIFIED.
  8. CONTRACTOR TO VERIFY STATUS OF ALL UTILITIES PRIOR TO INTERURBATION.
  9. EXPLORATORY EXCAVATIONS SHALL BE PERFORMED BY THE CONTRACTOR AT CONDITIONS PRIOR TO PERFORMING WORK.
  10. BEFORE CONSTRUCTING LINES TO CONNECT TO EXISTING UTILITIES, VERIFY EXISTING UTILITY INVERTS AND NOTIFY THE ENGINEER IF ANY VARIATION FROM THE PLAN IS REQUIRED.
  11. THE CONTRACTOR SHALL MAINTAIN ALL EXISTING UTILITIES IN SERVICE FOR THE DURATION OF THE WORK.
  12. THE CONTRACTOR SHALL COMPLY WITH ALL REQUIRED PERMITS AND ASSOCIATED CONDITIONS.
  13. CONTRACTOR SHALL BE RESPONSIBLE FOR DEWATERING UTILITY TRENCHES AND EXCAVATIONS AND FOR THE MAINTENANCE OF SURFACE DRAINAGE DURING THE COURSE OF THE WORK.
  14. IF ROCK REMOVAL BY BLASTING IS REQUIRED, THE CONTRACTOR SHALL OBTAIN ALL NECESSARY APPROVALS AND PERMITS REQUIRED BY THE AUTHORITY HAVING JURISDICTION.
  15. WATER AND SEWER UTILITIES SHALL BE PRIVATELY OWNED AND OPERATED.

**LEGEND:**

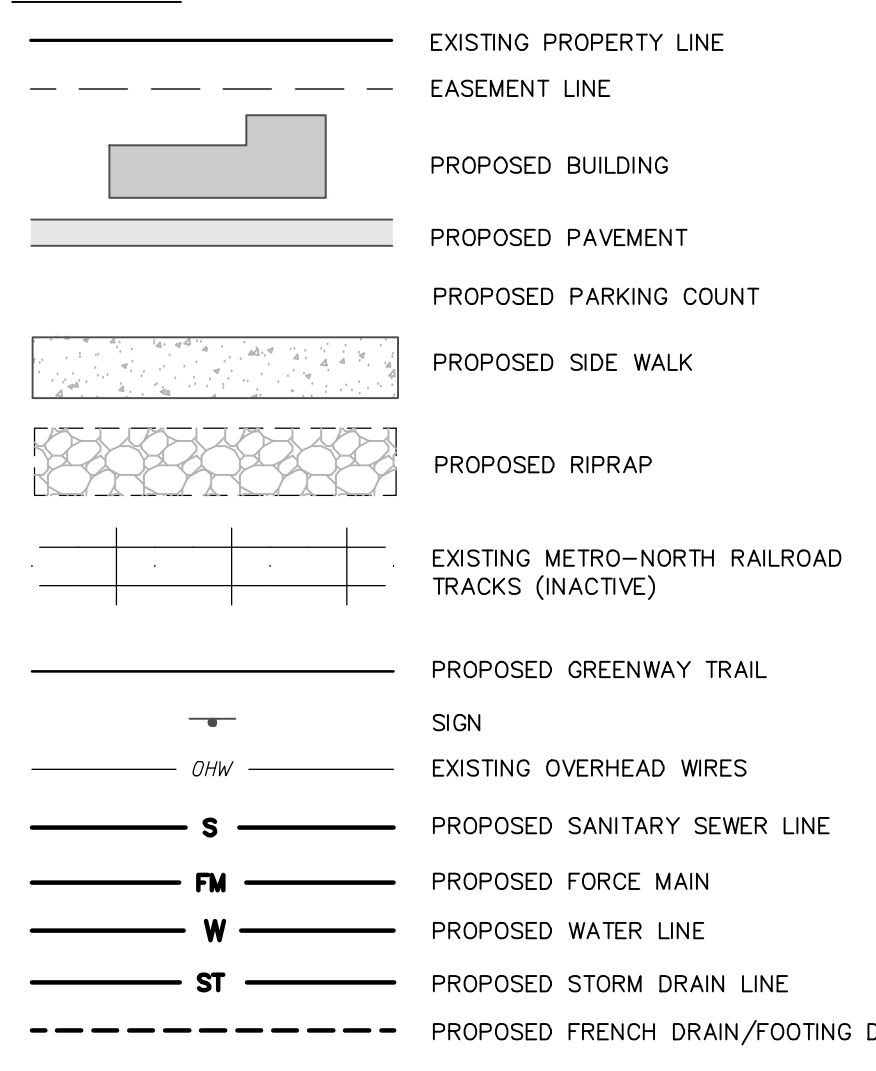

**EMERGENCY STANDBY GENERATOR:**

1. A STANDBY EMERGENCY GENERATOR SHALL BE PROVIDED TO ENSURE CONTINUOUS OPERATION OF THE PUMP STATION DURING POWER FAILURE. THE EMERGENCY GENERATOR SHALL HAVE ADEQUATE CAPACITY TO ACCOMMODATE THE FULL ELECTRICAL LOAD OF THE PROPOSED PUMP STATION (AS WITH ALL PUMPS RUNNING (STAGGERED STARTS)). THE CONTRACTOR SHALL VERIFY AND CONFIRM THE SIZE OF THE EMERGENCY GENERATOR WITH THE MANUFACTURER PRIOR TO SHOP DRAWING SUBMITTAL BASED ON THE SELECTED PUMPS AND STATION EQUIPMENT.
  - 2.4L V4 ENGINE
  - AUTOMATIC TRANSFER SWITCH
  - SOUND ATTENUATED WEATHER PROTECTIVE ENCLOSURE
  - CONTROL PANEL WITH RUN/STOP/START/TEST
  - RUN-OFF-AUTO SWITCH, RUNNING TIME METER, CRITICAL-GRADE EXHAUST
  - SILENCER, AUTOMATIC BATTERY CHARGER, GENERATOR ALARM STATUS PANEL, OIL PRESSURE GAUGE
  - 24/7 EXPOSURE CLOCK TIMER
  - HIGH TEMPERATURE AND LOW OIL PRESSURE SHUTDOWN
2. THE EMERGENCY GENERATOR SHALL BE A 25 KW/40HZ NATURAL GAS ENGINE GENERATOR SET MODEL 61025A AS MANUFACTURED BY GENERAC OR APPROVED EQUAL. THE UNIT SHALL BE EQUIPPED WITH THE FOLLOWING APPURTENANCES AND ACCESSORIES:
  - 2.4L V4 ENGINE
  - AUTOMATIC TRANSFER SWITCH
  - SOUND ATTENUATED WEATHER PROTECTIVE ENCLOSURE
  - CONTROL PANEL WITH RUN/STOP/START/TEST
  - RUN-OFF-AUTO SWITCH, RUNNING TIME METER, CRITICAL-GRADE EXHAUST
  - SILENCER, AUTOMATIC BATTERY CHARGER, GENERATOR ALARM STATUS PANEL, OIL PRESSURE GAUGE
  - 24/7 EXPOSURE CLOCK TIMER
  - HIGH TEMPERATURE AND LOW OIL PRESSURE SHUTDOWN
3. THE EMERGENCY GENERATOR SHALL BE INSTALLED ON A REINFORCED CONCRETE PAD OF SUFFICIENT DIMENSIONS WITHIN THE PROPOSED FENCE ENCLOSURE. GENERATOR SHALL BE SETBACK A DISTANCE FROM FENCE TO ALLOW REQUIRED MAINTENANCE ON IT IN ACCORDANCE WITH MANUFACTURER'S REQUIREMENTS.

**1 UTILITY PLAN**  
SCALE: 1"=30'

**WATER USAGE CALCULATIONS:**

APARTMENT BUILDINGS	FLOW (GPD)
1) APARTMENT (66 BEDROOMS * 110 GPD/BEDROOM)	10560
TOTALS:	10560 GPD

COMMERCIAL BUILDING	FLOW (GPD)
1) BLDG SF * (0.1 GPD/SF) = 25,000 * 0.1	2500
2) 20% REDUCTION FOR WATER SAVING PLUMBING	-500
TOTALS:	2000 GPD

COMBINED TOTAL: 12560 GPD  
OR 523 GPH  
OR 8.72 GPM  
MAXIMUM DAILY FLOW (USING FACTOR OF 2) = 8.72 GPM x 2 = 17.44 GPM  
PEAK HOURLY FLOW (USING FACTOR OF 4) = 8.72 GPM x 4 = 34.88 GPM  
REFERENCE: HYDSEC DESIGN STANDARDS FOR WASTEWATER TREATMENT SYSTEMS, LATEST EDITION

**2 UTILITY PLAN**  
SCALE: 1"=30'

**Dig Safely. New York.**  
Call Before You Dig  
Mark the Required Time  
Complete the Response  
Respect the Marks  
800-962-7962  
www.digsafely.com

ALL RIGHTS RESERVED. COPY OR REPRODUCTION OF THIS DRAWING OR DOCUMENT OR ANY PORTION THEREOF WITHOUT THE EXPRESS WRITTEN PERMISSION OF CHAZEN ENGINEERING, LAND SURVEYING & LANDSCAPE ARCHITECTURE, INC. IS STRICTLY PROHIBITED. NO PART OF THIS DRAWING OR DOCUMENT IS TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM. ANY REPRODUCTION OR TRANSMISSION OF THIS DRAWING OR DOCUMENT WITHOUT THE WRITTEN PERMISSION OF CHAZEN ENGINEERING, LAND SURVEYING & LANDSCAPE ARCHITECTURE, INC. IS STRICTLY PROHIBITED. IF A VIOLATION OF NEW YORK STATE EDUCATION LAW FOR ANY PERSON TO ALTER THIS DRAWING OR DOCUMENT IN ANY WAY UNLESS HE OR SHE IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL PROFESSIONAL ENGINEER, LAND SURVEYOR, ARCHITECT OR LANDSCAPE ARCHITECT. IF THIS DRAWING OR DOCUMENT IS ALTERED OR REPRODUCED IN ANY MANNER, THE USER SHALL BE RESPONSIBLE FOR OBTAINING THE NECESSARY APPROVALS AND PERMITS FROM THE APPROPRIATE AGENCIES AND A SPECIFIC DESCRIPTION OF THE ALTERATION.

**CHAZEN ENGINEERING, LAND SURVEYING & LANDSCAPE ARCHITECTURE CO., D.P.C.**  
Office Locations:  
North Country Office: 31 Van Street, Plattsburgh, New York 12861  
Capital District Office: 241 New York State Office Building, Albany, New York 12242  
Saratoga Springs Office: 100 North Broadway, Saratoga Springs, New York 12158  
Utica Office: 100 North Broadway, Utica, New York 13502  
Schenectady Office: 100 North Broadway, Schenectady, New York 12305  
Troy Office: 100 North Broadway, Troy, New York 12180  
Watkins Glen Office: 100 North Broadway, Watkins Glen, New York 14881  
Westerlo Office: 100 North Broadway, Westerlo, New York 12190  
Canton Office: 100 North Broadway, Canton, New York 13616  
Delhi Office: 100 North Broadway, Delhi, New York 13830  
Malone Office: 100 North Broadway, Malone, New York 14858  
Rensselaer Office: 100 North Broadway, Rensselaer, New York 12150  
Schenectady Office: 100 North Broadway, Schenectady, New York 12305  
Troy Office: 100 North Broadway, Troy, New York 12180  
Watkins Glen Office: 100 North Broadway, Watkins Glen, New York 14881  
Westerlo Office: 100 North Broadway, Westerlo, New York 12190  
Canton Office: 100 North Broadway, Canton, New York 13616  
Delhi Office: 100 North Broadway, Delhi, New York 13830  
Malone Office: 100 North Broadway, Malone, New York 14858  
Rensselaer Office: 100 North Broadway, Rensselaer, New York 12150

REV.	DATE	DESCRIPTION
1	10/15/18	REVISED FOR INTERNAL REVIEW
2	12/20/18	REVISED PER PLANNING BOARD COMMENTS
3	01/22/19	REVISED PER PLANNING BOARD COMMENTS

248 TIORONDA AVE., BEACON, N.Y.  
**UTILITY PLAN**  
CITY OF BEACON, DUTCHESS COUNTY, NEW YORK  
Designed by: [Signature]  
Checked by: [Signature]  
Date: 09/10/18  
Scale: 1"=30'  
Sheet No.: 8 of 17  
Project No.: 181750.00