
<u>SEWER DETAILS</u>



INCE IC COMEL

Owner: Beacon HIP Lofts, LLC 39 Front Street Beacon, NY 12508

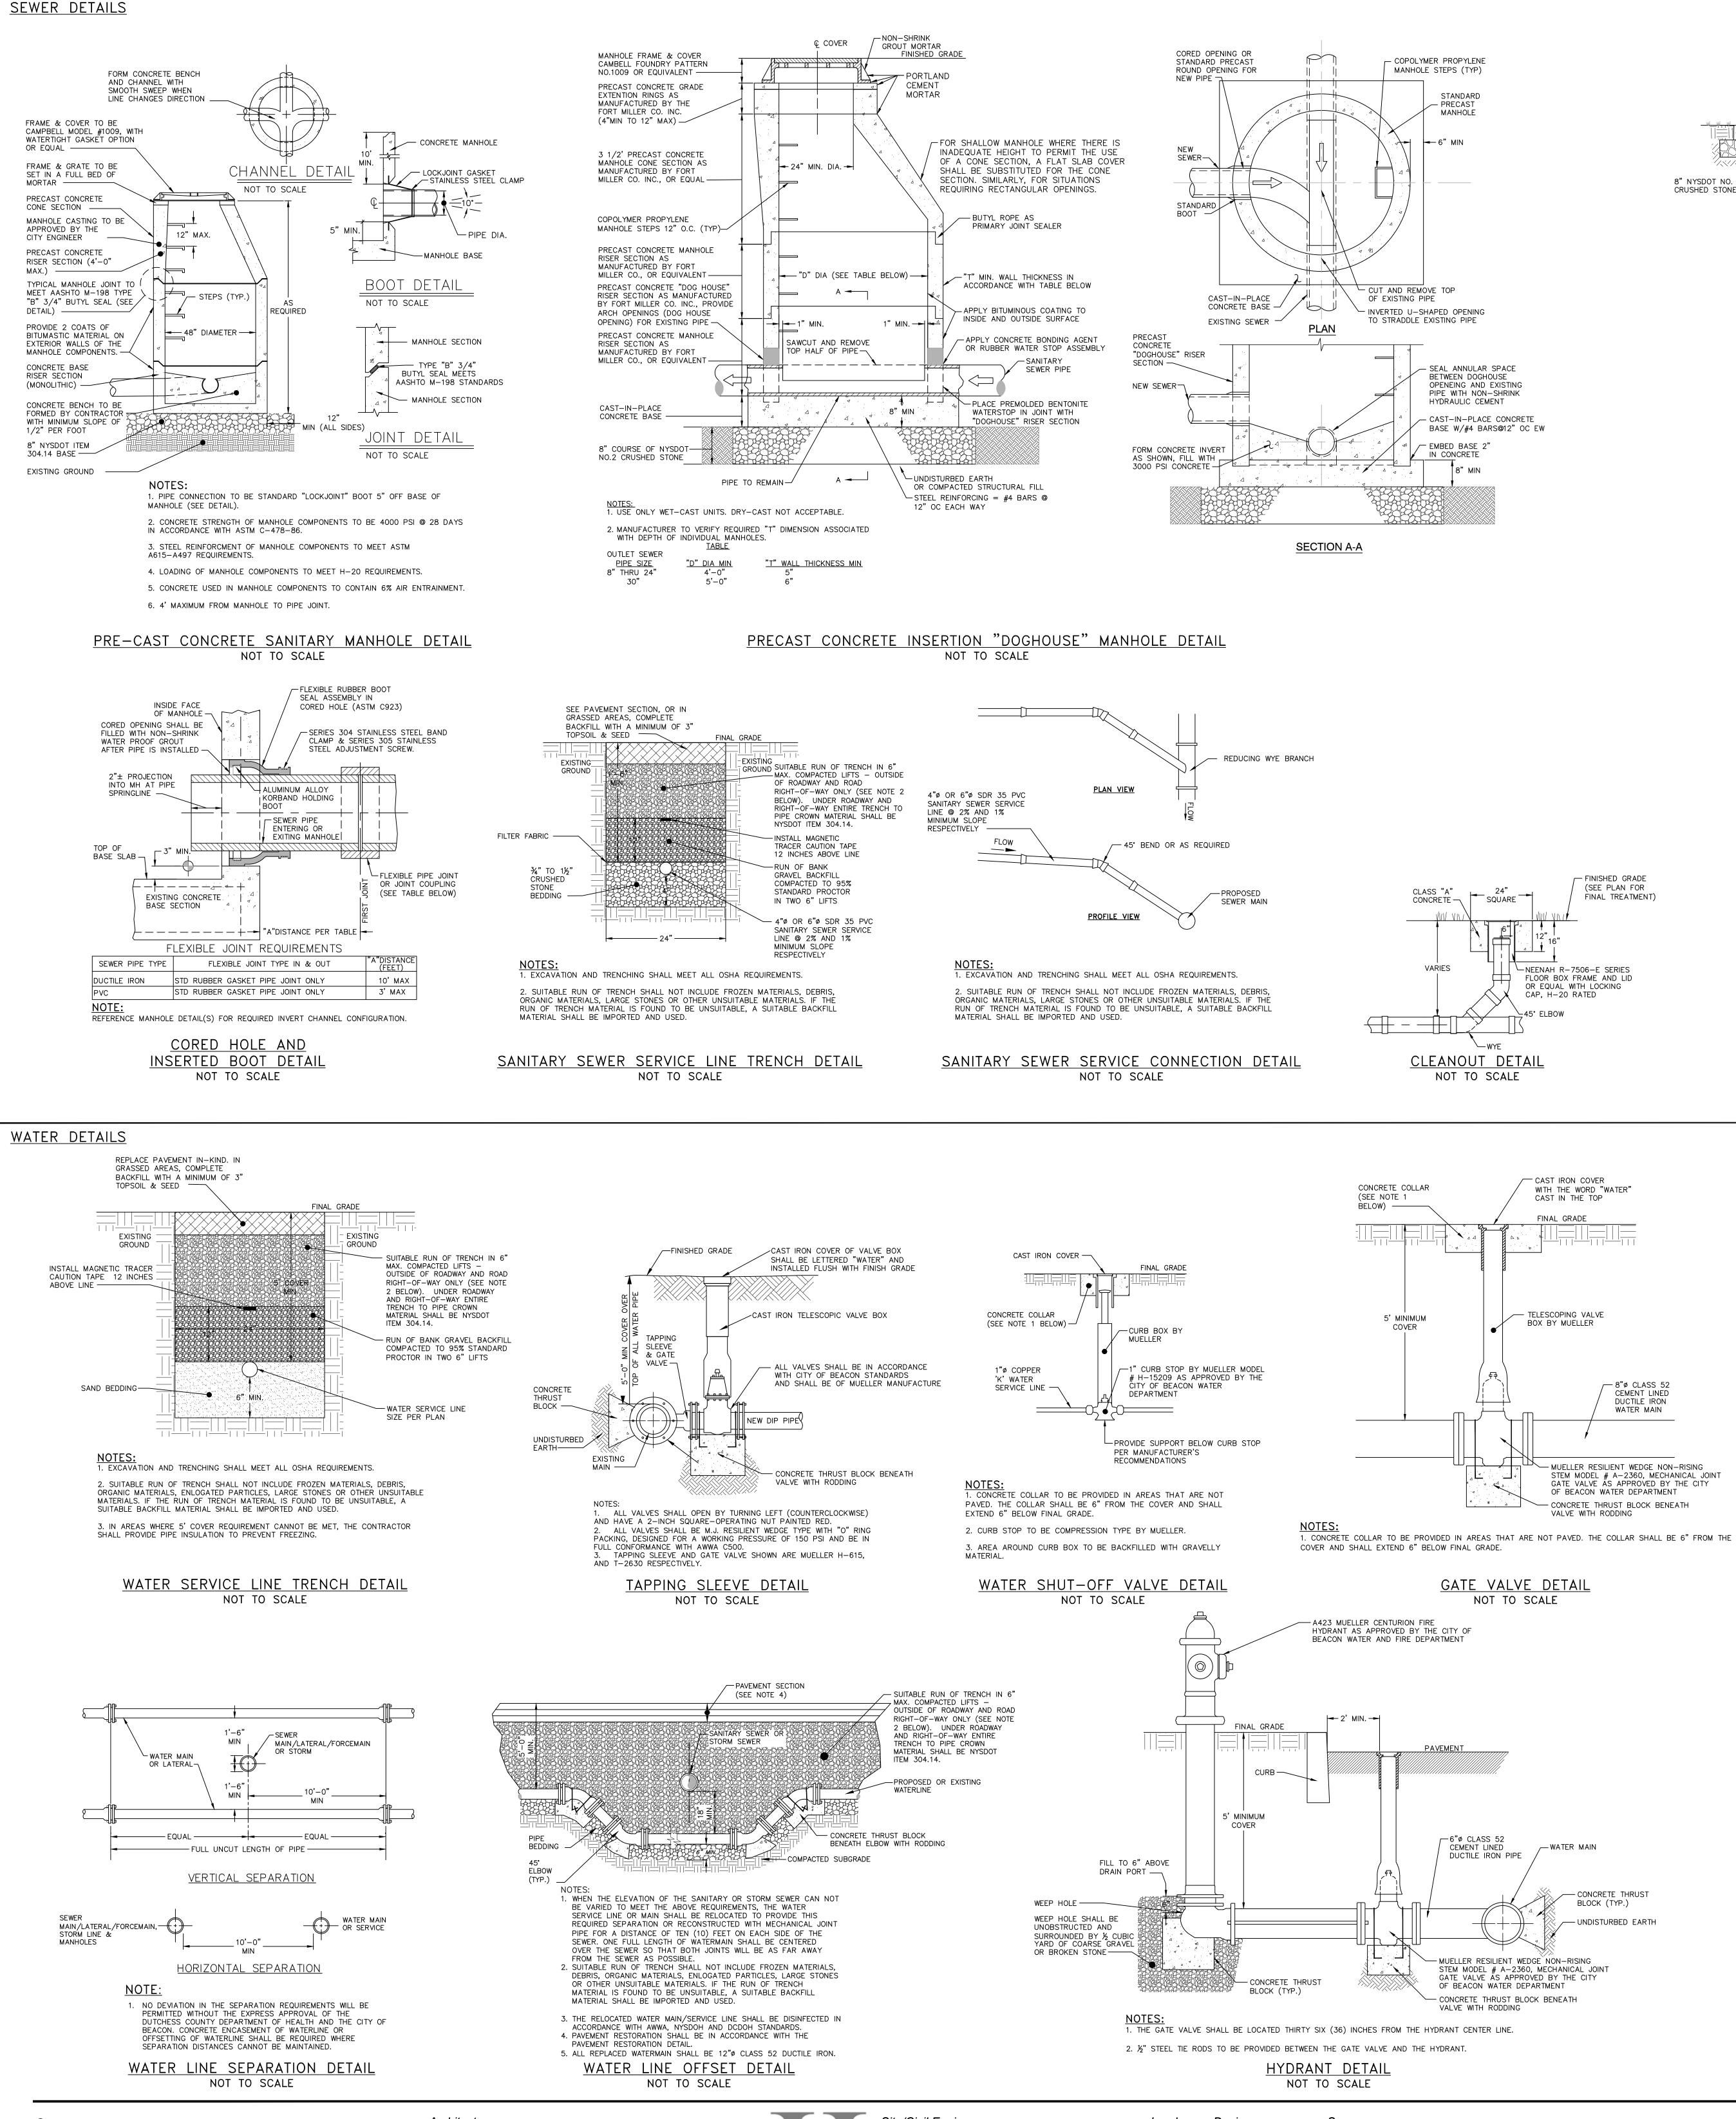



Arych Siegel, Architect

Beacon, New York 12508





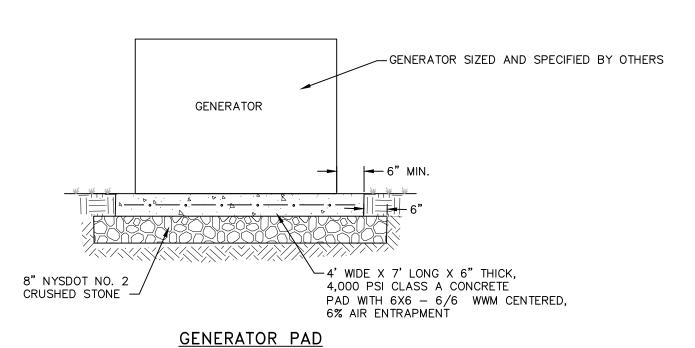

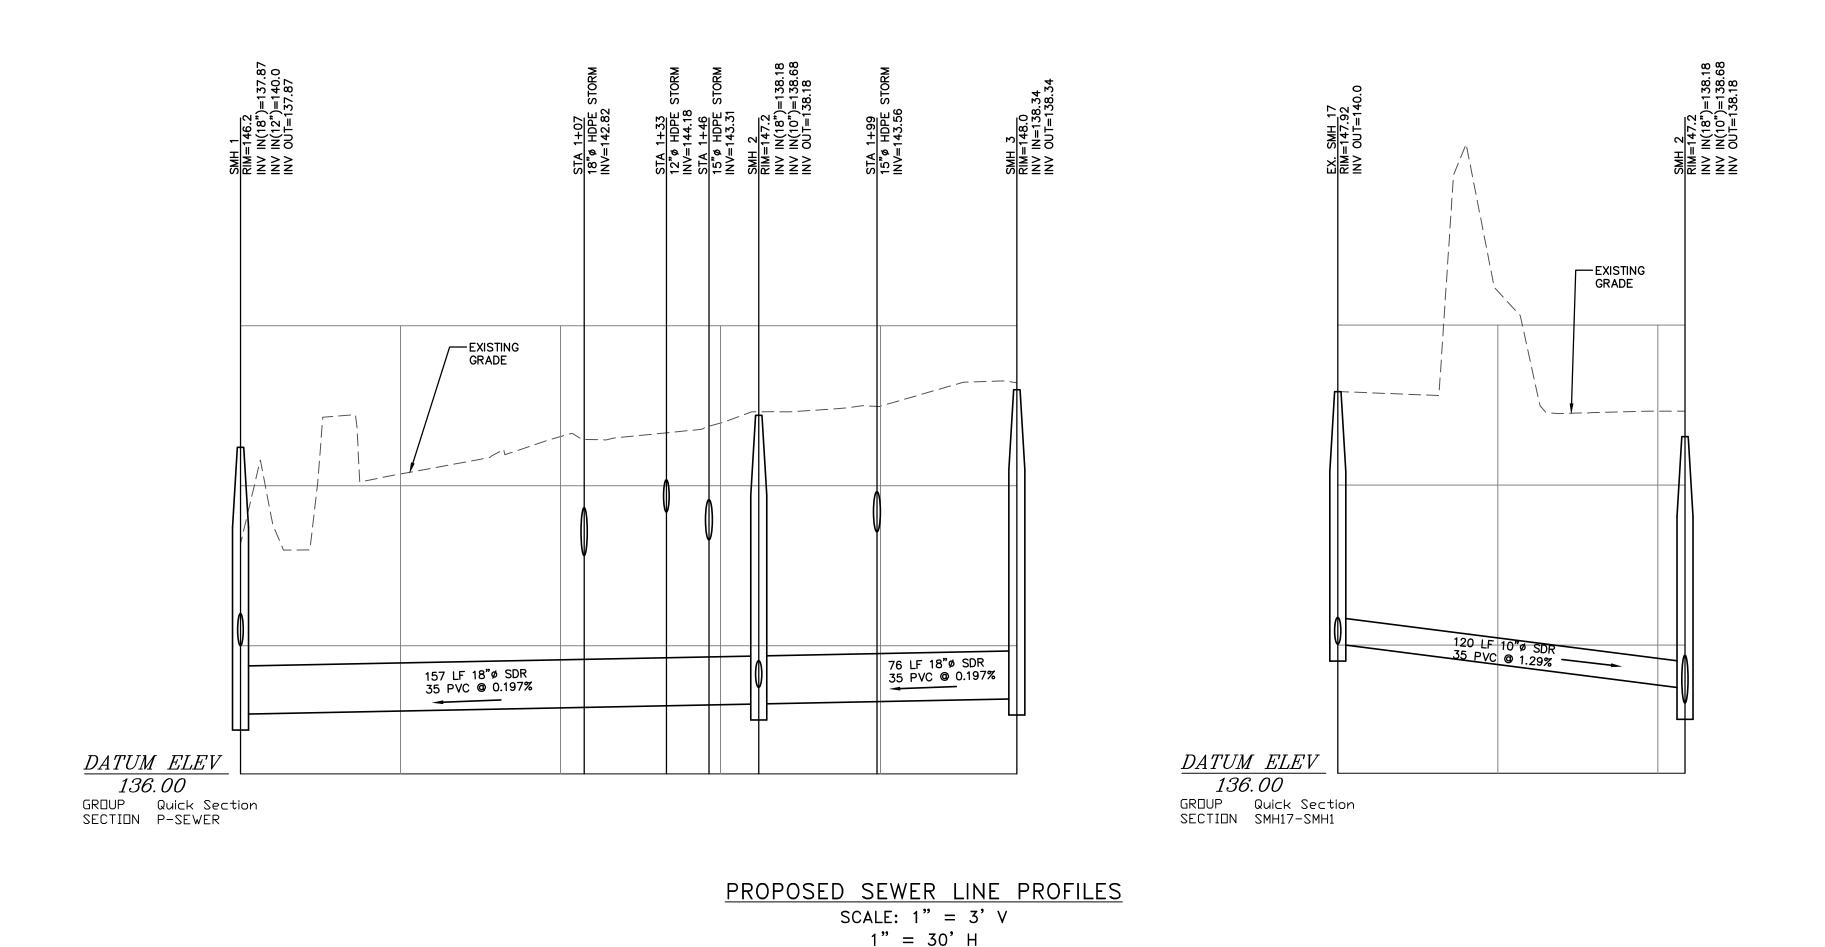

└─NEENAH R-7506-E SERIES FLOOR BOX FRAME AND LID OR EQUAL WITH LOCKING CAP, H—20 RATED ___45° ELBOW

- FINISHED GRADE

(SEE PLAN FOR


FINAL TREATMENT)

CAST IRON COVER WITH THE WORD "WATER" CAST IN THE TOP FINAL GRADE

- TELESCOPING VALVE BOX BY MUELLER

> CEMENT LINED DUCTILE IRON WATER MAIN - MUELLER RESILIENT WEDGE NON-RISING

STEM MODEL # A-2360, MECHANICAL JOINT GATE VALVE AS APPROVED BY THE CITY OF BEACON WATER DEPARTMENT - CONCRETE THRUST BLOCK BENEATH VALVE WITH RODDING

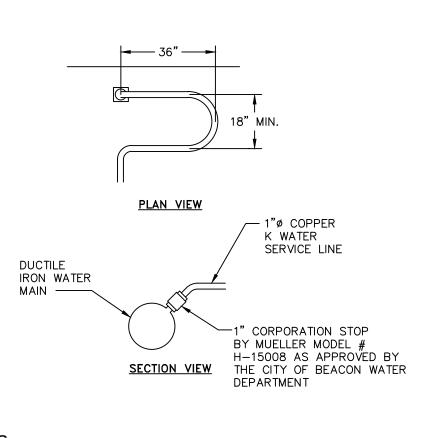


NOTES: 1. A MINIMUM 5' COVER SHALL BE PROVIDED ON THE WATER SERVICE LINE (CONDITIONED ON ACTUAL WATER MAIN DEPTH). 2. CORPORATION STOP TO BE COMPRESSION TYPE BY MUELLER. 3. WATER SERVICE LINE TO HAVE A 'GOOSENECK' NEAR CORPORATION STOP. 4. CORPORATION STOP TO BE INSTALLED IN THE UPPER HALF OF THE WATER MAIN AT AN ANGLE OF APPROXIMATELY 45' FROM HORIZONTAL.

WATER SERVICE CONNECTION DETAIL NOT TO SCALE

RECOMMENDED FOR APPROVAL: MAYOR OF THE CITY OF BEACON APPROVED BY RESOLUTION OF THE CITY COUNCIL OF THE CITY OF BEACON ON THE _____ DAY OF _____, 20____, APPROVED BY RESOLUTION OF THE PLANNING BOARD OF THE CITY OF BEACON, NEW YORK, ON THE ______ DAY OF ______, 20____, SUBJECT TO ALL REQUIREMENTS AND CONDITIONS OF SAID RESOLUTION. ANY CHANGE, ERASURE, MODIFICATION OR REVISION OF THIS PLAT, AS APPROVED, SHALL VOID THIS APPROVAL. - CONCRETE THRUST BLOCK (TYP.) - UNDISTURBED EARTH SIGNED THIS ______ DAY OF _____, 20____, BY _ CHAIRMAN _ SECRETARY IN ABSENCE OF THE CHAIRMAN OR SECRETARY, THE ACTING CHAIRMAN OR ACTING SECRETARY

RESPECTIVELY MAY SIGN IN THIS PLACE.

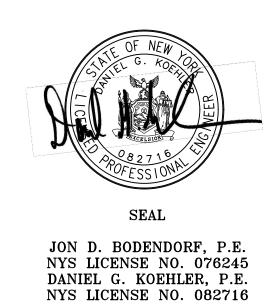

REVISIONS:			
NO.	DATE	DESCRIPTION	ΒY
1	8/29/17	NO CHANGE THIS SHEET	CMB
2	9/26/17	NO CHANGE	CMB

Amendment to Special Use Permit Water and Sewer Details

Sheet 10 of 10

Beacon HIP Lofts Beacon, New York Scale: As Noted July 25, 2017