



PROPOSED SEWER LINE PROFILES SCALE: 1" = 3' V

1" = 30' H

## WATER DETAILS REPLACE PAVEMENT IN-KIND. IN

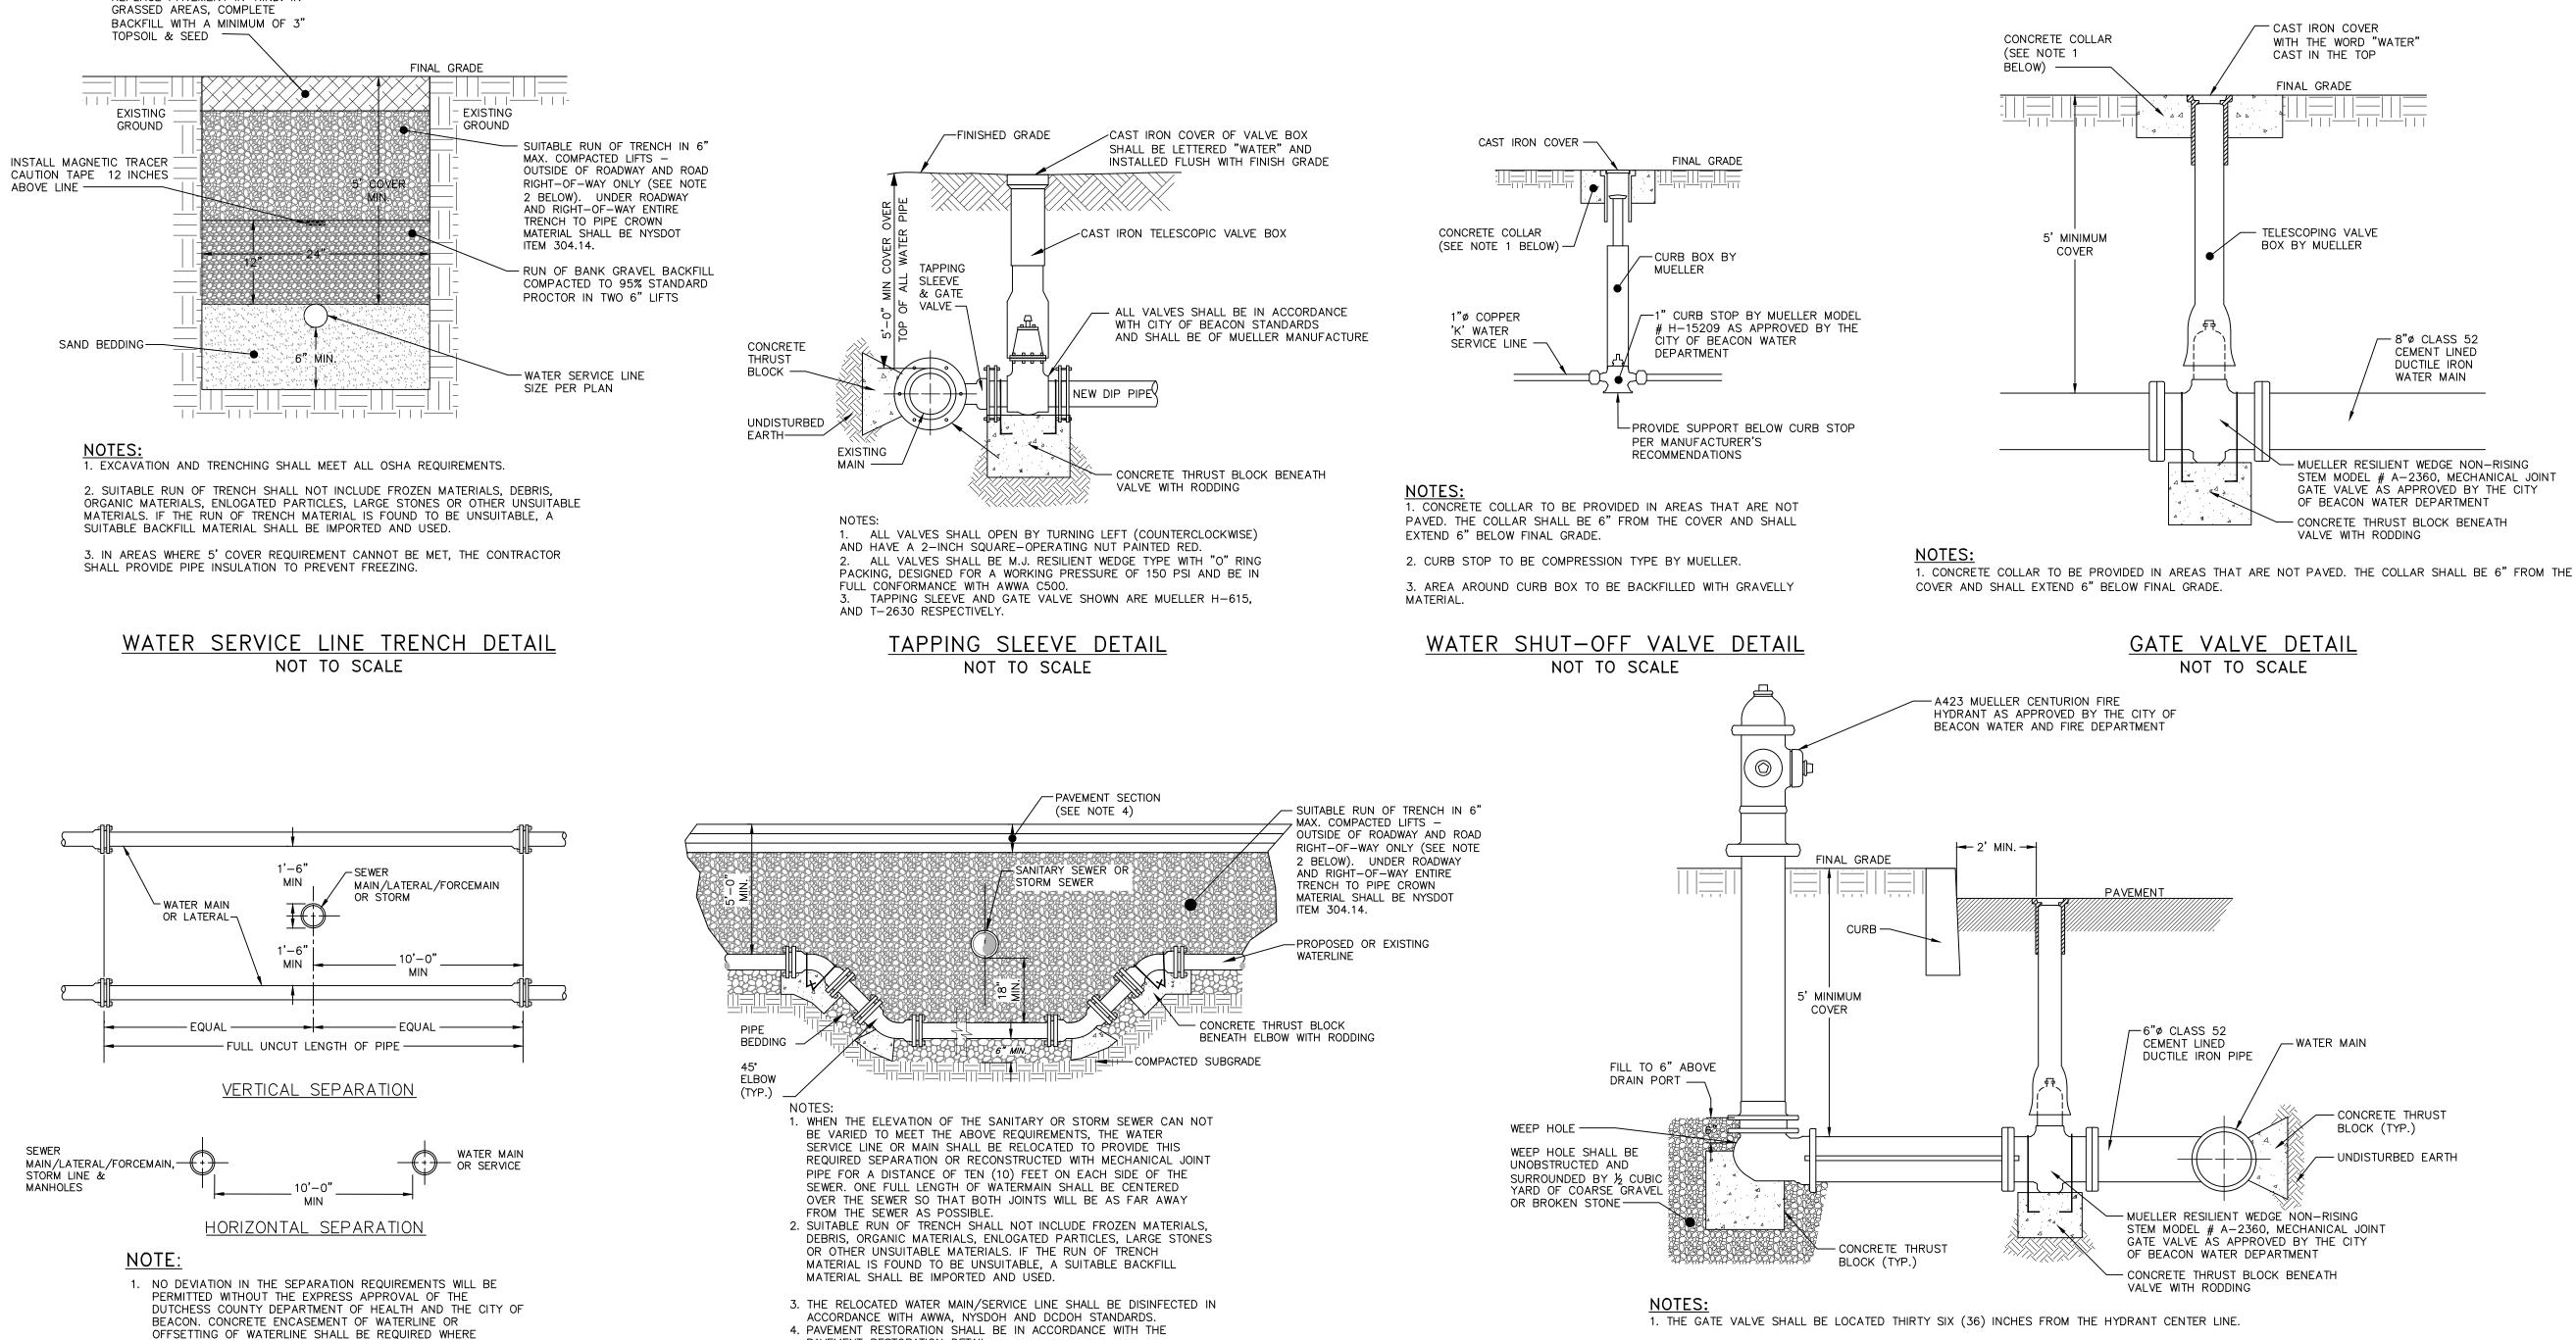

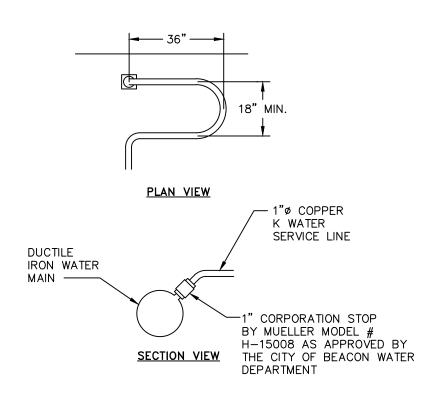


1. A MINIMUM 5' COVER SHALL BE PROVIDED ON THE WATER SERVICE LINE (CONDITIONED ON ACTUAL WATER MAIN DEPTH). 2. CORPORATION STOP TO BE COMPRESSION TYPE BY MUELLER. 3. WATER SERVICE LINE TO HAVE A 'GOOSENECK' NEAR CORPORATION 4. CORPORATION STOP TO BE INSTALLED IN THE UPPER HALF OF THE WATER MAIN AT AN ANGLE OF APPROXIMATELY 45° FROM

WATER SERVICE CONNECTION DETAIL NOT TO SCALE

RECOMMENDED FOR APPROVAL:

MAYOR OF THE CITY OF BEACON APPROVED BY RESOLUTION OF THE CITY COUNCIL OF THE CITY OF BEACON ON THE \_\_\_\_\_, 20\_\_\_\_, APPROVED BY RESOLUTION OF THE PLANNING BOARD OF THE CITY OF BEACON, NEW YORK, ON THE \_\_\_\_\_\_ DAY OF \_\_\_\_\_\_, 20\_\_\_\_, SUBJECT TO ALL REQUIREMENTS AND CONDITIONS OF SAID RESOLUTION. ANY CHANGE, ERASURE, MODIFICATION OR REVISION OF THIS PLAT, AS APPROVED, SHALL VOID THIS APPROVAL. SIGNED THIS \_\_\_\_\_, 20\_\_\_\_, BY \_ CHAIRMAN \_ SECRETARY IN ABSENCE OF THE CHAIRMAN OR SECRETARY, THE ACTING CHAIRMAN OR ACTING SECRETARY RESPECTIVELY MAY SIGN IN THIS PLACE.

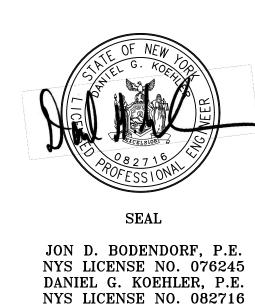

REVI	SIONS:		
NO.	DATE	DESCRIPTION	В
1	8/29/17	NO CHANGE THIS SHEET	СМ
2	9/26/17	NO CHANGE	СМ
3	10/31/17	NO CHANGE	СМ
4	11/28/17	NO CHANGE	СМ
· · · · · · · · · · · · · · · · · · ·			

**Amendment to Special Use Permit** Water and Sewer Details Sheet 10 of 10

SEPARATION DISTANCES CANNOT BE MAINTAINED.

WATER LINE SEPARATION DETAIL

NOT TO SCALE

PAVEMENT RESTORATION DETAIL.

5. ALL REPLACED WATERMAIN SHALL BE 12" CLASS 52 DUCTILE IRON.

WATER LINE OFFSET DETAIL

NOT TO SCALE

2. 1/2" STEEL TIE RODS TO BE PROVIDED BETWEEN THE GATE VALVE AND THE HYDRANT.

HYDRANT DETAIL

NOT TO SCALE