


NOTES:

1. PRECAST CONCRETE CATCH BASIN WITH CONCRETE STRENGTH OF 4,000 PSI @ 28 DAYS.
2. THE ENDS OF ALL PIPES SHALL BE CUT OFF FLUSH WITH THE INSIDE SURFACE OF THE CATCH BASIN AND PARGED AROUND.
3. PIPES SHALL BE PARGED AROUND INTERIOR AND EXTERIOR PRIOR TO BACKFILLING OF STRUCTURE. CONNECTIONS MADE WITHIN 10 FEET OF A WATER MAIN (OR SERVICE LINE) OR A SEWER MAIN (OR SERVICE LATERAL) SHALL BE MADE WATERTIGHT.
4. PROVIDE A MINIMUM 0.1" DROP BETWEEN INLET AND OUTLET INVERTS (MATCH CROWNS FOR PIPES WITH DIFFERENT SIZE) UNLESS OTHERWISE NOTED ON THE PLAN.
5. CATCH BASINS WITH AN INTERIOR DEPTH OF 4' AND GREATER SHALL BE FURNISHED WITH STEEL REINFORCED POLYPROPYLENE PLASTIC STEPS AT 12" INTERVALS.
6. HDPE PIPE SHALL BE PROVIDED WITH WATERTIGHT CONNECTIONS. ADS MODEL N12 WT IB OR APPROVED EQUAL.


CATCH BASIN DETAIL NOT TO SCALE

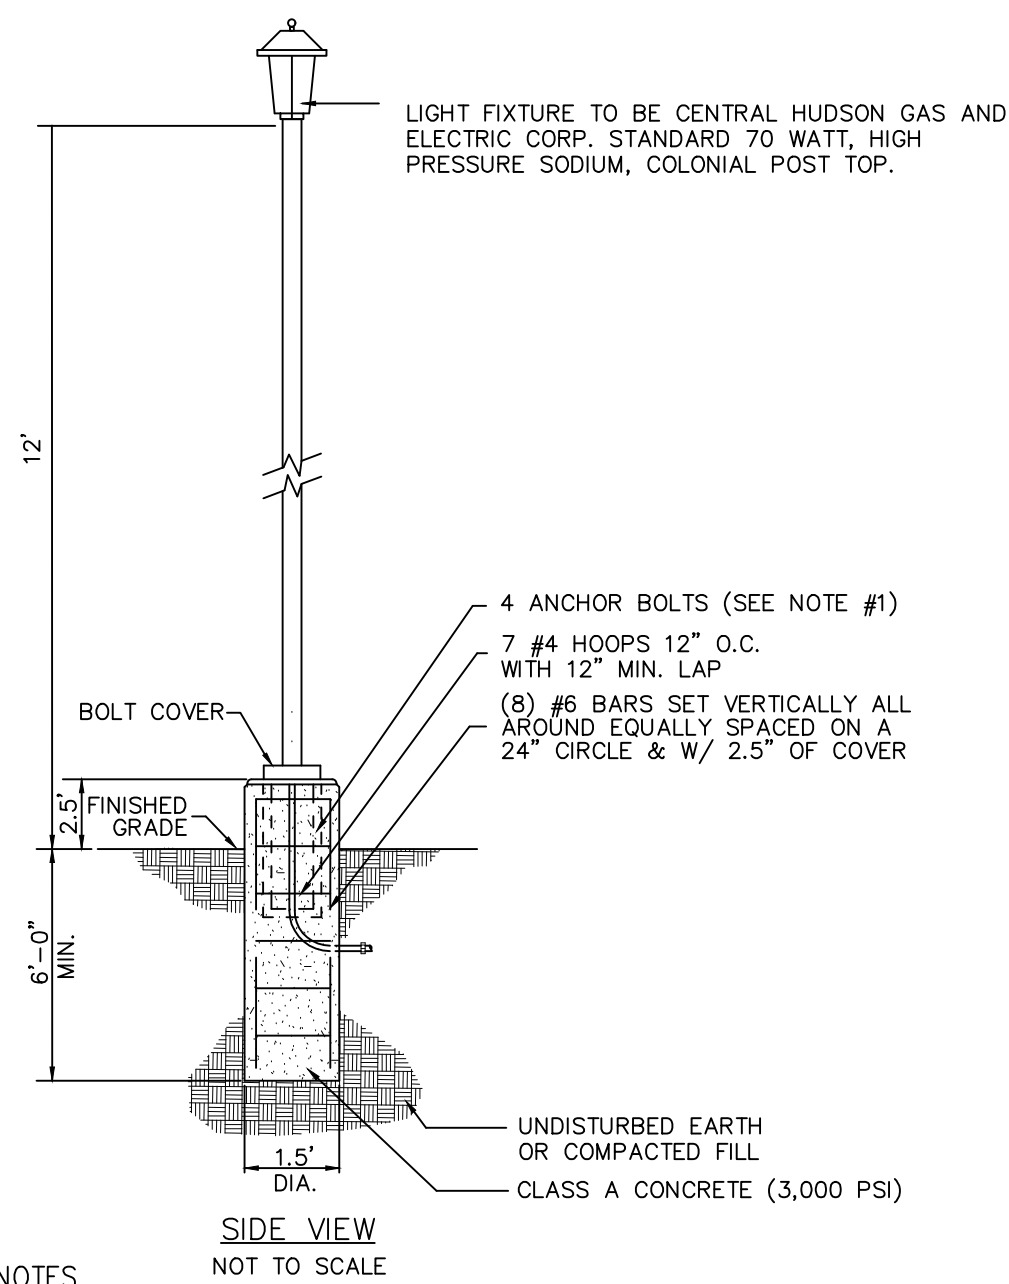

NOTES:

1. LIGHT FIXTURE SHALL BE DIRECTED AND/OR SHADED AS NECESSARY TO PREVENT LIGHT FROM SPILLING OFF-SITE AND TO PREVENT UNREASONABLE GLARE FROM BEING OBSERVED ON ADJACENT ROADWAY OR PROPERTY.


POLE AND LUMINAIRE DETAIL NOT TO SCALE

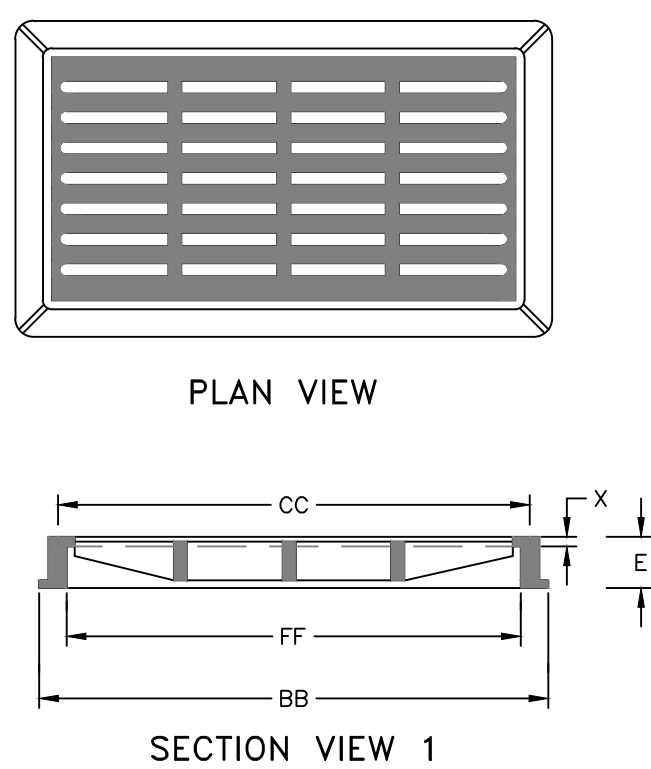

NOTES:

1. HEAVY DUTY RECTANGULAR STORMWATER INLET GRATE TO BE CAMPBELL FOUNDRY MODEL 3433, OR APPROVED EQUAL.
2. DMH 11 RECEIVES A SOLID CAST IRON COVER.

CAST IRON STORMWATER FLAT INLET GRATE DETAIL NOT TO SCALE

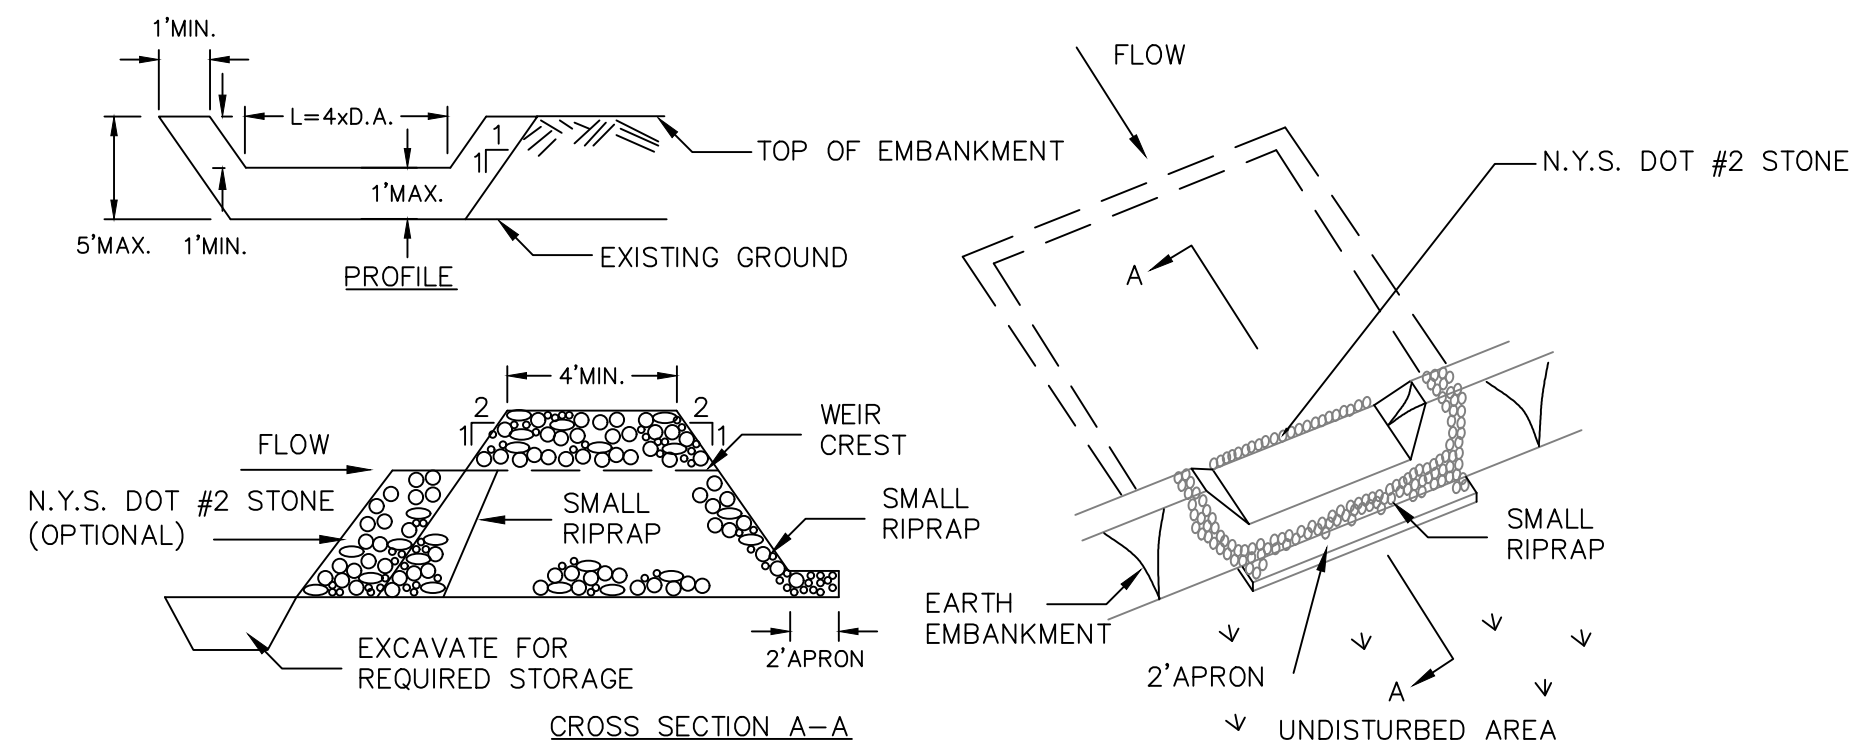


CONSTRUCTION SPECIFICATIONS

OPTION: A ONE FOOT LAYER OF N.Y.S. DOT #2 STONE MAY BE PLACED ON THE UPSTREAM SIDE OF THE RIPRAP IN PLACE OF THE EMBEDDED FILTER CLOTH.

1. AREA UNDER EMBANKMENT SHALL BE CLEARED, GRUBBED AND STRIPPED OF ANY VEGETATION AND ROOT MAT. THE POOL AREA SHALL BE CLEARED.
2. THE FILL MATERIAL FOR THE EMBANKMENT SHALL BE FREE OF ROOTS AND OTHER WOODY VEGETATION AS WELL AS OVER-SIZED STONES, ROCKS, ORGANIC MATERIAL OR OTHER OBJECTIONABLE MATERIAL. THE EMBANKMENT SHALL BE COMPACTED BY TRAVERSING WITH EQUIPMENT WHILE IT IS BEING CONSTRUCTED.
3. ALL CUT AND FILL SLOPES SHALL BE 2:1 OR FLATTER.
4. THE STONE USED IN THE OUTLET SHALL BE SMALL RIPRAP 4"-8" ALONG WITH A 1" THICKNESS OF 2" AGGREGATE PLACED ON THE UP-GRADE SIDE ON THE SMALL RIPRAP OR EMBEDDED FILTER CLOTH IN THE RIPRAP.
5. SEDIMENT SHALL BE REMOVED AND TRAP RESTORED TO ITS ORIGINAL DIMENSIONS WHEN THE SEDIMENT HAS ACCUMULATED TO 1/2 THE DESIGN DEPTH OF THE TRAP. IT SHALL BE PLACED ON SITE AND STABILIZED.
6. THE STRUCTURE SHALL BE INSPECTED AFTER EACH RAIN AND REPAIRS MADE AS NEEDED.
7. CONSTRUCTION OPERATIONS SHALL BE CARRIED OUT IN SUCH A MANNER THAT EROSION AND SEDIMENT ARE CONTROLLED.
8. THE STRUCTURE SHALL BE REMOVED AND THE AREA STABILIZED WHEN THE DRAINAGE AREA HAS BEEN PROPERLY STABILIZED.


STONE OUTLET SEDIMENT TRAP DETAIL NOT TO SCALE

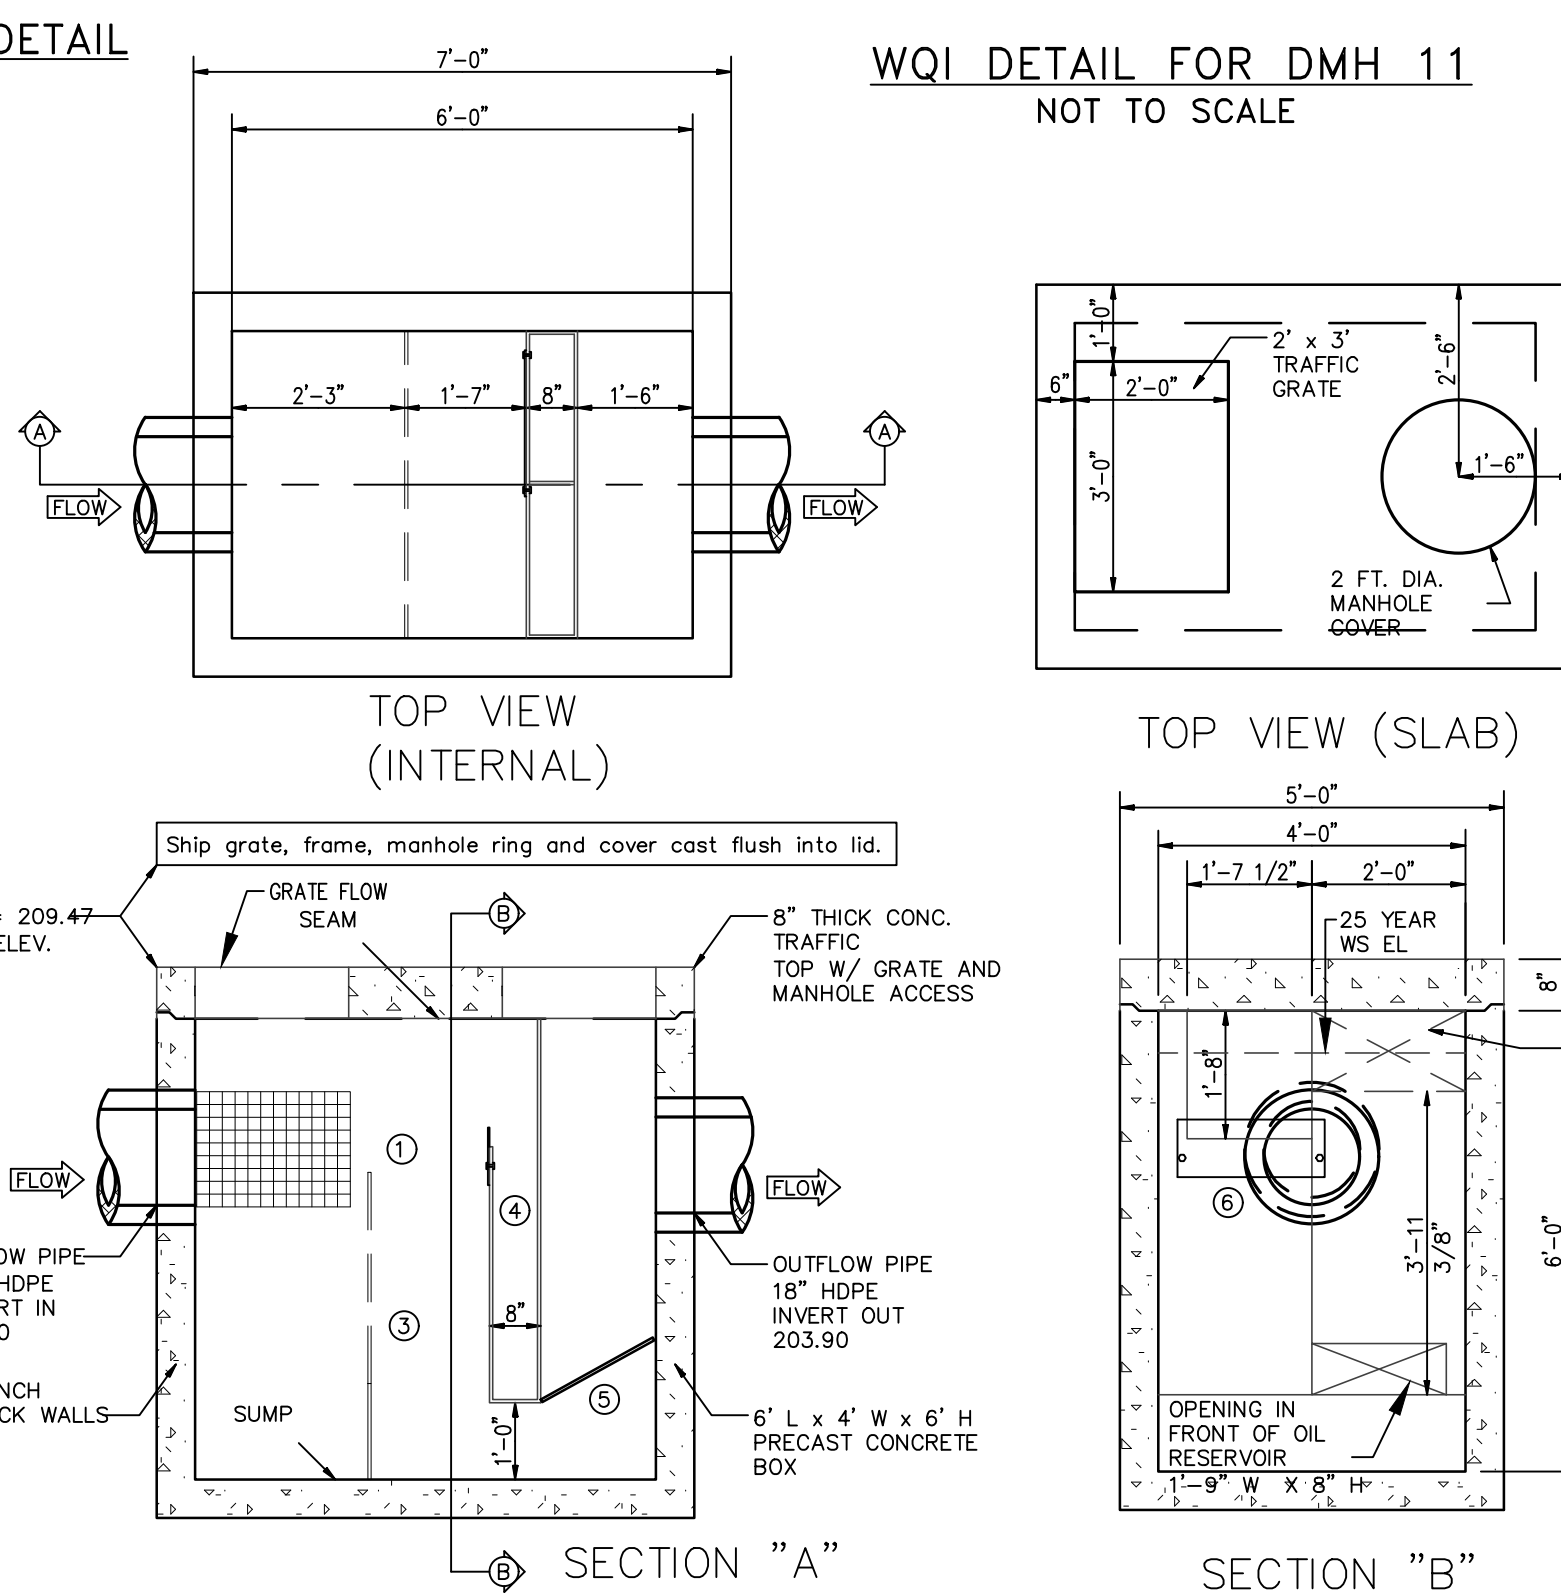

NOTES:

1. WATER QUALITY INLET SHOWN IS "CRYSTAL CLEAN" MODEL # 646 JB BY CRYSTAL STREAM TECHNOLOGIES, INC. OF LAWRENCEVILLE, GA., 1-800-648-6945.
2. ALL PIPES SHALL BE CONSTRUCTED TO BE FLUSH WITH THE INSIDE WALLS.
3. CONTRACTOR IS RESPONSIBLE FOR PROVIDING ALL PIPES AND STRUCTURES BETWEEN AND AROUND THE WATER QUALITY VAULTS.
4. ALL VAULT LIFTING CONNECTIONS SHALL BE LOCATED ON THE OUTSIDE OF THE VAULT WALLS.
5. CONCRETE VAULT PRE-CASTER IS RESPONSIBLE FOR THE STRUCTURAL INTEGRITY OF THE CONCRETE VAULTS. WALL AND SLAB THICKNESSES SHALL BE ALTERED ACCORDINGLY.

HYDRODYNAMIC DEVICE DETAIL NOT TO SCALE

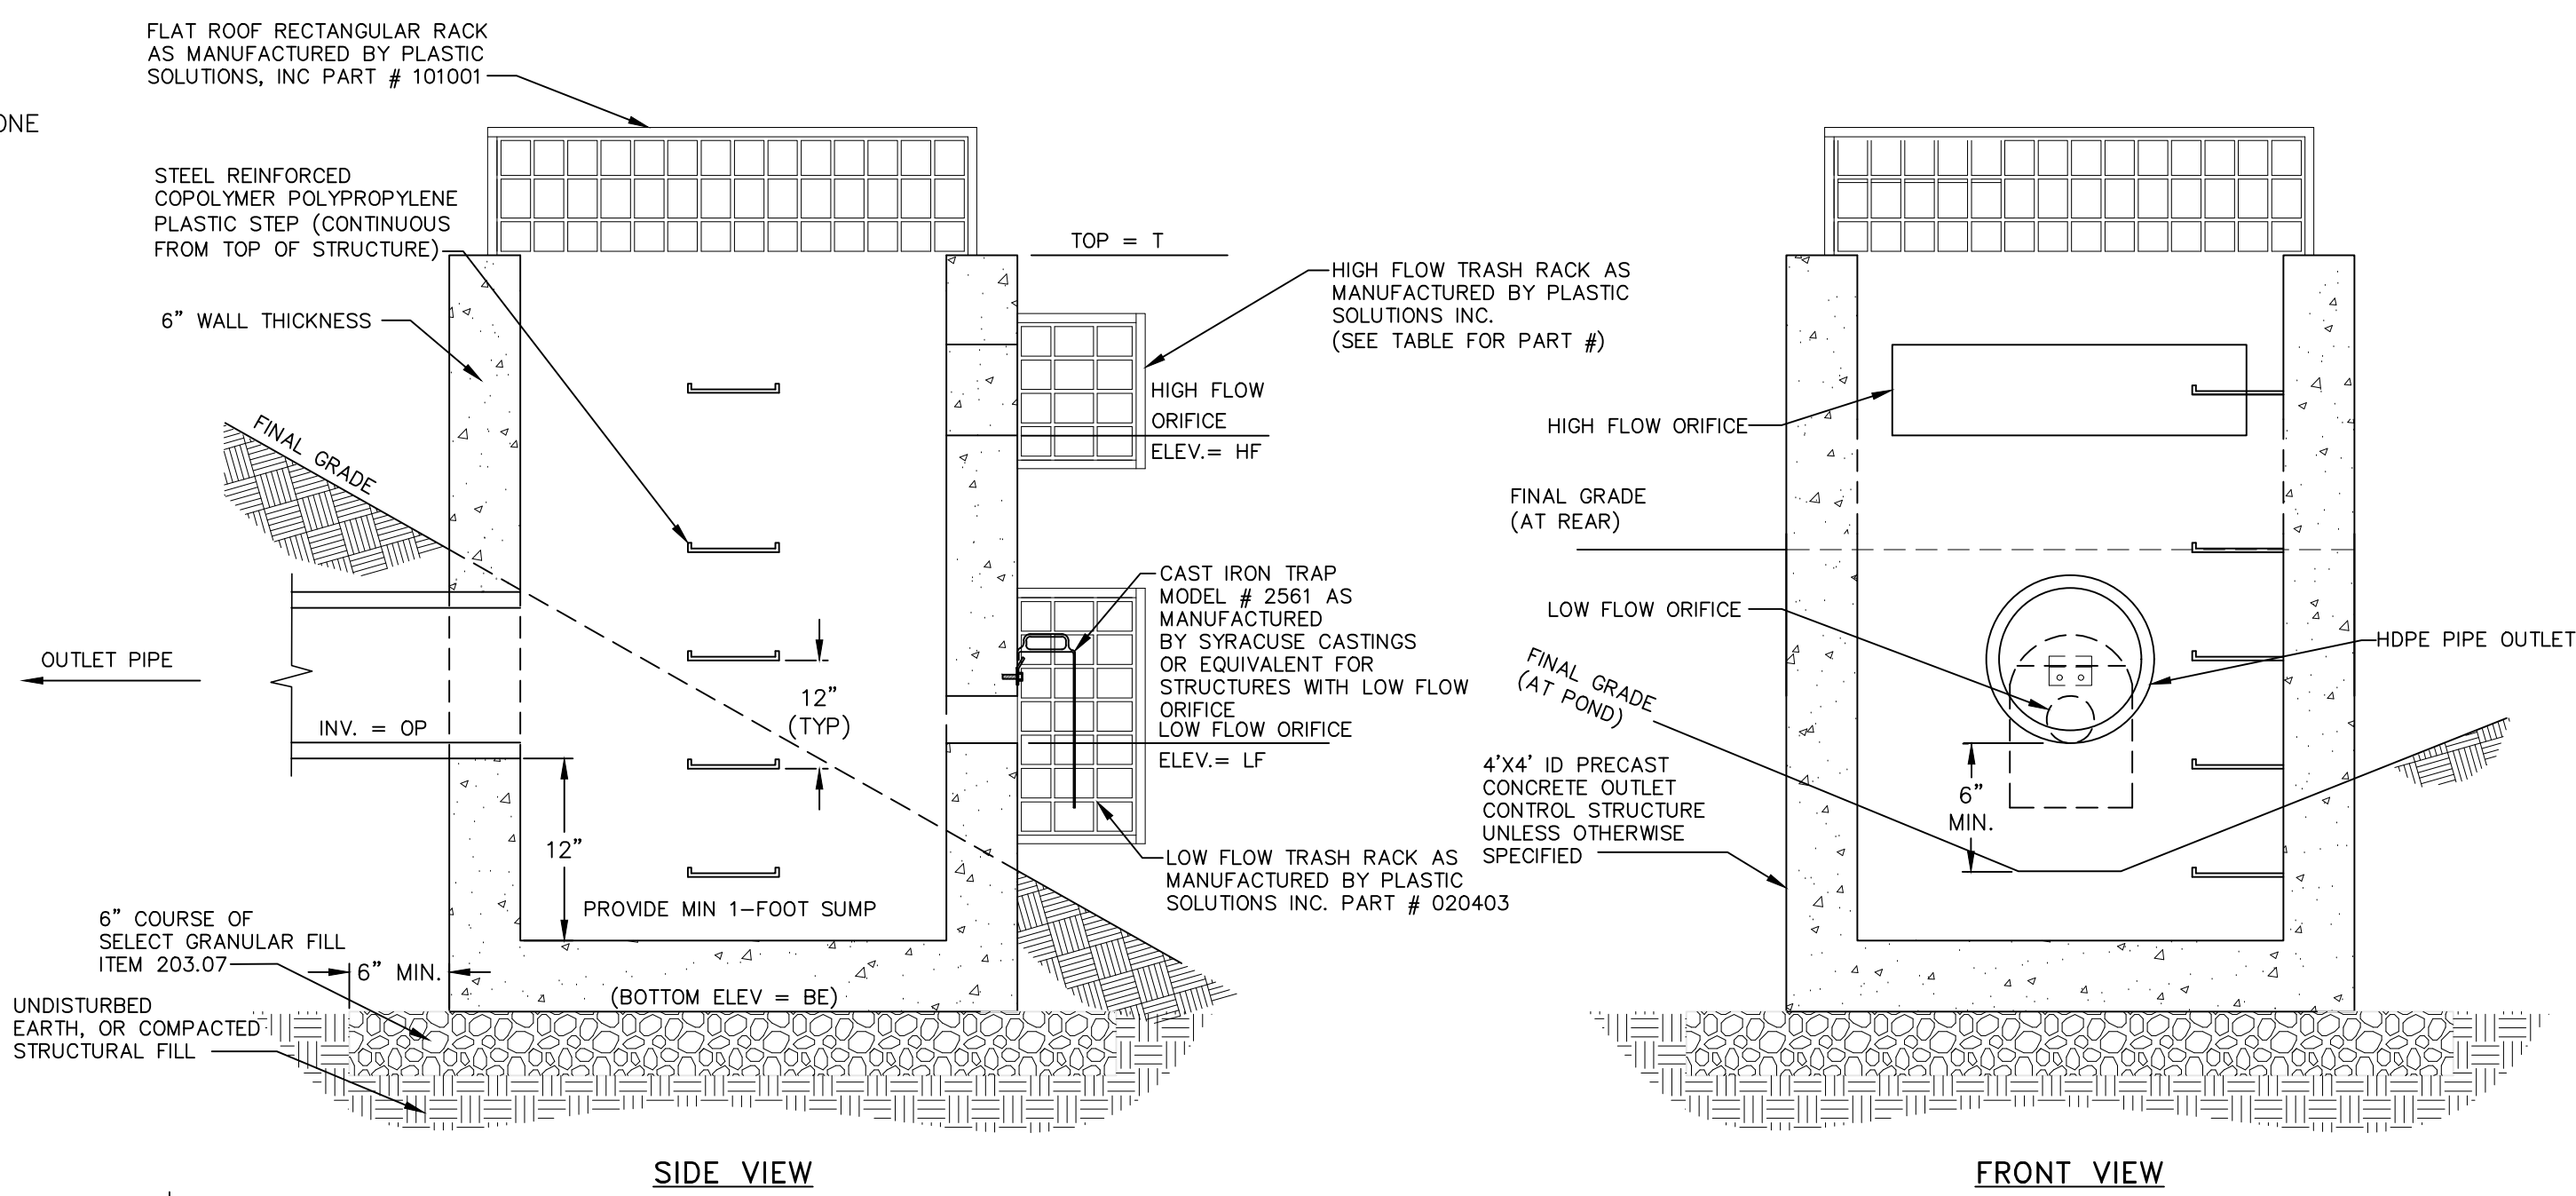


SIDE VIEW

OUTLET CONTROL STRUCTURE DATA									
OCS ID	STRUCTURE DIMENSIONS	LOW FLOW ORIFICE DIM. (IN)	"LF" (FT)	HIGH FLOW ORIFICE DIM	# OF HIGH FLOW INLETS	"HF" (FT)	"I" (FT)	OUTLET PIPE Ø (IN)	"Op" (FT)
15	4'x4' I.D.	6" Ø	198.5	6" X 36"	1	199.1	200.0	18	197.00

NOTES:

1. ALL TRASH RACKS SHALL HAVE UV PROTECTION MEETING OR EXCEEDING THE REQUIREMENTS OF ASTM D2565-99.
2. TRASH RACKS SHALL BE SECURED PER THE MANUFACTURER'S RECOMMENDATIONS.
3. WHERE HIGH FLOW ORIFICE EXTENDS TO TOP OF STRUCTURE, THE MAXIMUM ALLOWABLE GAP BETWEEN THE TRASH RACKS SHALL BE 4".


INFILTRATION OUTLET CONTROL STRUCTURE DETAIL NOT TO SCALE

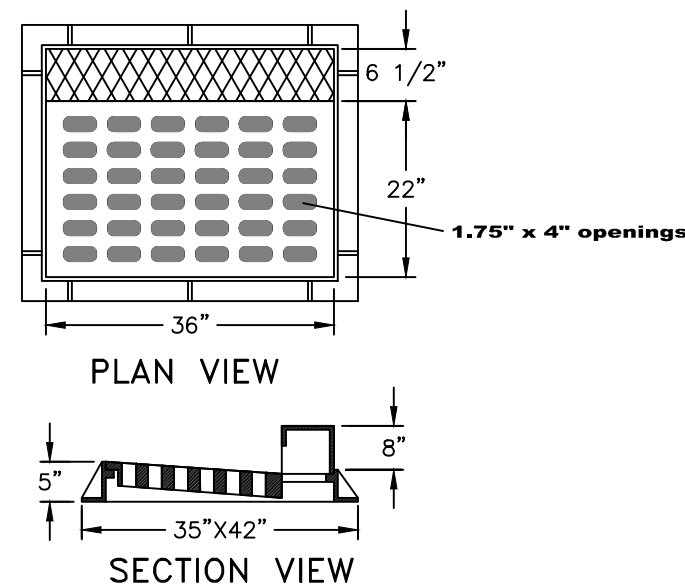

NOTES:

1. HEAVY DUTY RECTANGULAR STORMWATER INLET GRATE TO BE CAMPBELL FOUNDRY MODEL 2541, OR APPROVED EQUAL.
2. CATCH BASINS TO RECEIVE CURB INLETS ARE: CB 1 THROUGH CB 10.

CAST IRON STORMWATER CURB INLET GRATE DETAIL NOT TO SCALE

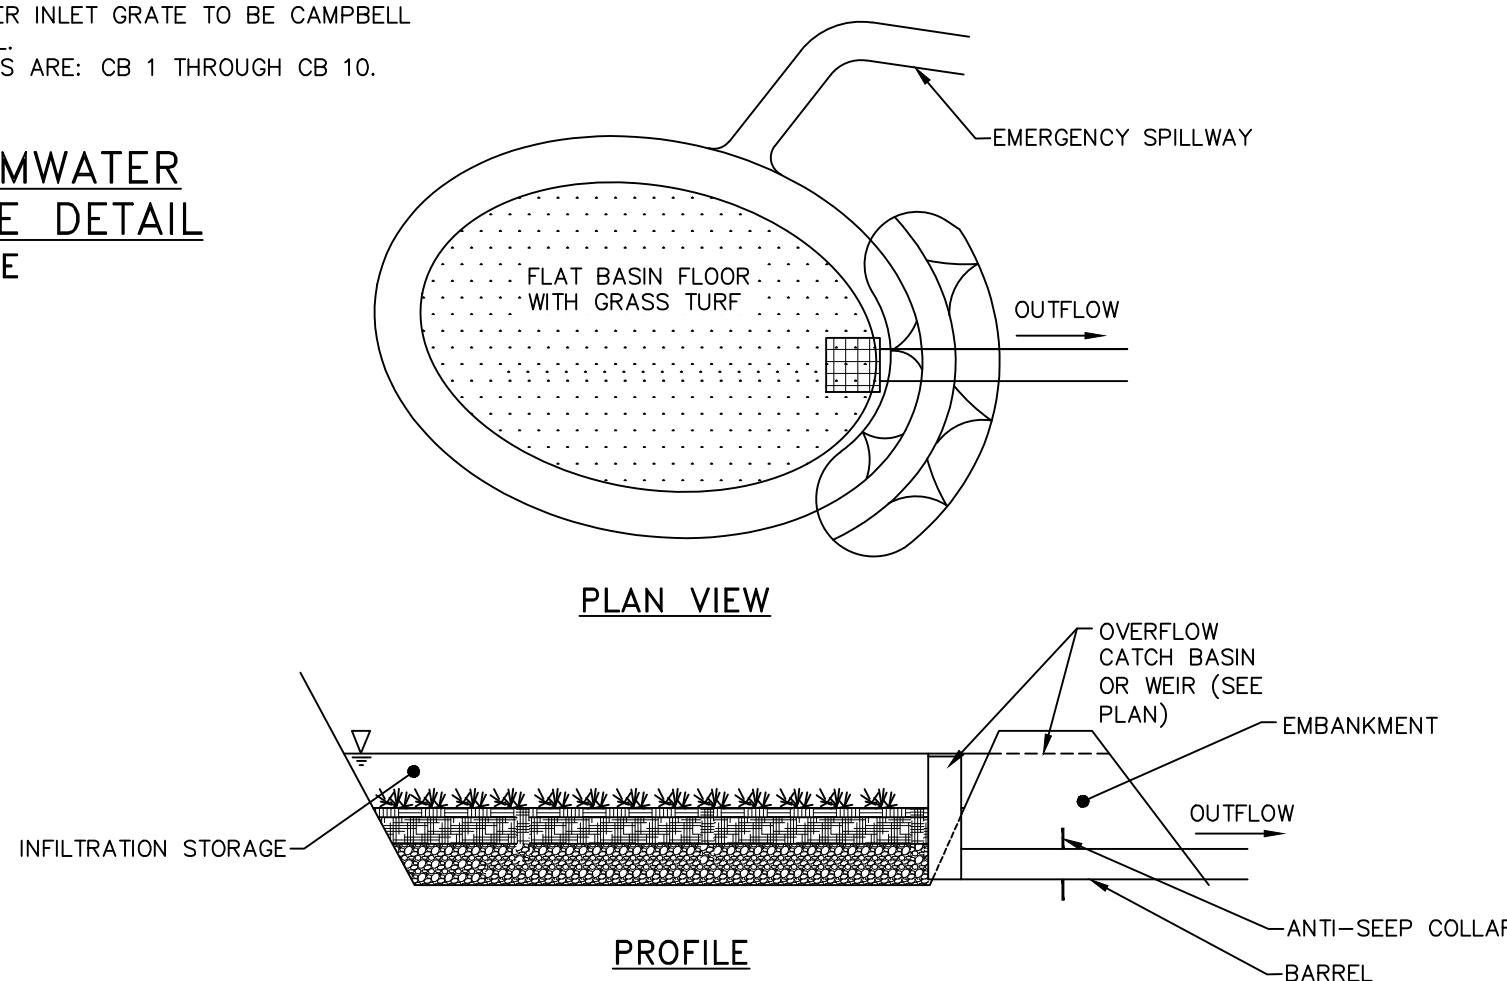

LEGEND

- ① EXPANDED ALUMINUM BASKET W/ 1/4" MESH LINING, 1'-6" H. x 2'-0" L x 4'-0" W. UPFR 3'-6 3/4" FROM SUMP
- ② 2ND INTERNAL BAFLE W/ 1" HOLES DRILLED AT 1 1/4" O.C., 4'-0" H.
- ③ SPILL PROTECTION RESERVOIR 5'-0" H. WITH A 1'-8" FRONT OUT.
- ④ 3/4" COCONUT FIBER FILTER IN ALUMINUM FRAME 1'-8" LONG.
- ⑤ 1/4" ALUMINUM PLATE, 9" H., 1'-11" WIDE.

NOTES:


1. THE INFILTRATION BASIN SHALL NOT SERVE AS A SEDIMENT TRAP DURING CONSTRUCTION AND SHALL BE PROTECTED FROM CONSTRUCTION ACTIVITY.
2. RELATIVELY LIGHT TRACKED EQUIPMENT IS RECOMMENDED FOR CONSTRUCTION PURPOSES TO AVOID COMPACTION OF THE BASIN FLOOR.
3. A HIGHLY POROUS SURFACE TEXTURE SHALL BE RETAINED ALONG THE BASIN FLOOR, ESPECIALLY WITHIN THE AREA IDENTIFIED AS BEING USED FOR INFILTRATION.
4. ESTABLISH DENSE VEGETATION ON THE BASIN SIDE SLOPES AND FLOOR TO PREVENT EROSION AND SLOUGHING AND TO PROVIDE A NATURAL MEANS OF MAINTAINING RELATIVELY HIGH INFILTRATION RATES. GRASSES OF THE FESCUE FAMILY (ALTAI FESCUE, WESTERN FESCUE OR RED FESCUE) ARE SPECIFIED ON THIS PLAN, PRIMARILY DUE TO THEIR ADAPTABILITY TO DRY SANDY SOILS, DROUGHT RESISTANCE, HARDINESS, AND ABILITY TO WITHSTAND BRIEF INUNDATIONS. FESCUE WILL ALSO ALLOW FOR LONG INTERVALS BETWEEN MOWINGS, WHICH SHALL OCCUR TWICE PER YEAR MINIMUM, TYPICALLY IN JUNE AND SEPTEMBER IS SATISFACTORY.
5. THE BERMS SHALL BE SUFFICIENTLY COMPACTED AND OF SUCH MATERIAL TO PREVENT SEEPAGE.

TYPICAL INFILTRATION BASIN DETAIL NOT TO SCALE

DRAWN BY: JDB CHECKED BY: MAB JOB NO.: 2015:025			
REVISIONS:			
NO.	DATE	DESCRIPTION	BY
1	02/27/18	PER PLANNING BOARD COMMENTS	CMB
2	03/27/18	PER PLANNING BOARD COMMENTS	JDB
3	05/29/18	PER PLANNING BOARD COMMENTS	AG


CONSTRUCTION DETAILS 25 TOWNSEND STREET

25 TOWNSEND STREET
CITY OF BEACON
DUTCHESS COUNTY, NEW YORK
TAX ID: 6055-03-383149
SCALE: AS SHOWN
DECEMBER 7, 2015

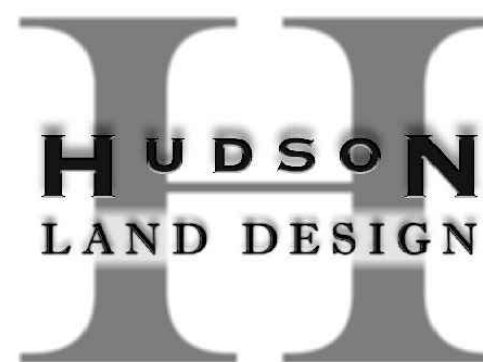

HUDSON LAND DESIGN
PROFESSIONAL ENGINEERING P.C.

174 MAIN STREET
BEACON, NEW YORK 12508
PH: 845-440-6926 F: 845-440-6637

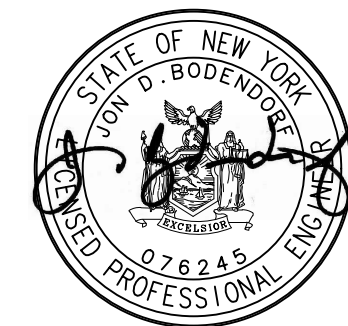

SEAL

JON D. BODENDORF, P.E.
NYS LICENSE NO. 076245
DANIEL G. KOEHLER, P.E.
NYS LICENSE NO. 082716

SHEET: 7 OF 8